

GENERATOR POWER QUALITY - DATA SUMMARY

Ten West 66th St. Corp.

11/01/07 to 11/30/07

	Line 1			Line 2			Line 3			Totals		
	Min	Avg	Max	Min	Avg	Max	Min	Avg	Max	Min	Avg	Max
Voltage (V)	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a
Current (amps)	1.65	95.47	103.45	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a
True Power (kW)	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	0.6	61.4	68.9
Apparent Power (kVA)	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a
Power Factor (-)	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a
Voltage THD (%)	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a
Current THD (%)	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a
Frequency (hz)	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a


GENERATOR POWER QUALITY - DATA SUMMARY

Ten West 66th St. Corp.

11/01/07 to 11/30/07

Date	Good Data (%)	Generator Apparent Power (kVAh)	Generator Reactive Power (kVARh)	Generator True Power (kWh)	Power Factor (-)
11/01/07	100.00	n/a	n/a	1359.78	n/a
11/02/07	100.00	n/a	n/a	1425.12	n/a
11/03/07	100.00	n/a	n/a	1449.21	n/a
11/04/07	100.00	n/a	n/a	1432.24	n/a
11/05/07	100.00	n/a	n/a	1421.60	n/a
11/06/07	100.00	n/a	n/a	1441.32	n/a
11/07/07	100.00	n/a	n/a	1501.85	n/a
11/08/07	100.00	n/a	n/a	1540.60	n/a
11/09/07	100.00	n/a	n/a	734.90	n/a
11/10/07	100.00	n/a	n/a	0.00	n/a
11/11/07	100.00	n/a	n/a	0.00	n/a
11/12/07	100.00	n/a	n/a	0.00	n/a
11/13/07	100.00	n/a	n/a	0.00	n/a
11/14/07	100.00	n/a	n/a	0.00	n/a
11/15/07	100.00	n/a	n/a	792.99	n/a
11/16/07	100.00	n/a	n/a	1504.33	n/a
11/17/07	100.00	n/a	n/a	1542.64	n/a
11/18/07	100.00	n/a	n/a	1518.97	n/a
11/19/07	100.00	n/a	n/a	1546.53	n/a
11/20/07	100.00	n/a	n/a	1504.60	n/a
11/21/07	100.00	n/a	n/a	1417.47	n/a
11/22/07	100.00	n/a	n/a	1350.30	n/a
11/23/07	100.00	n/a	n/a	1535.99	n/a
11/24/07	100.00	n/a	n/a	1592.17	n/a
11/25/07	100.00	n/a	n/a	1509.61	n/a
11/26/07	100.00	n/a	n/a	1439.98	n/a
11/27/07	100.00	n/a	n/a	1392.50	n/a
11/28/07	100.00	n/a	n/a	1519.69	n/a
11/29/07	100.00	n/a	n/a	1461.24	n/a
11/30/07	100.00	n/a	n/a	1535.21	n/a
Total	100.00	n/a	n/a	35470.82	n/a

Generator Output Power

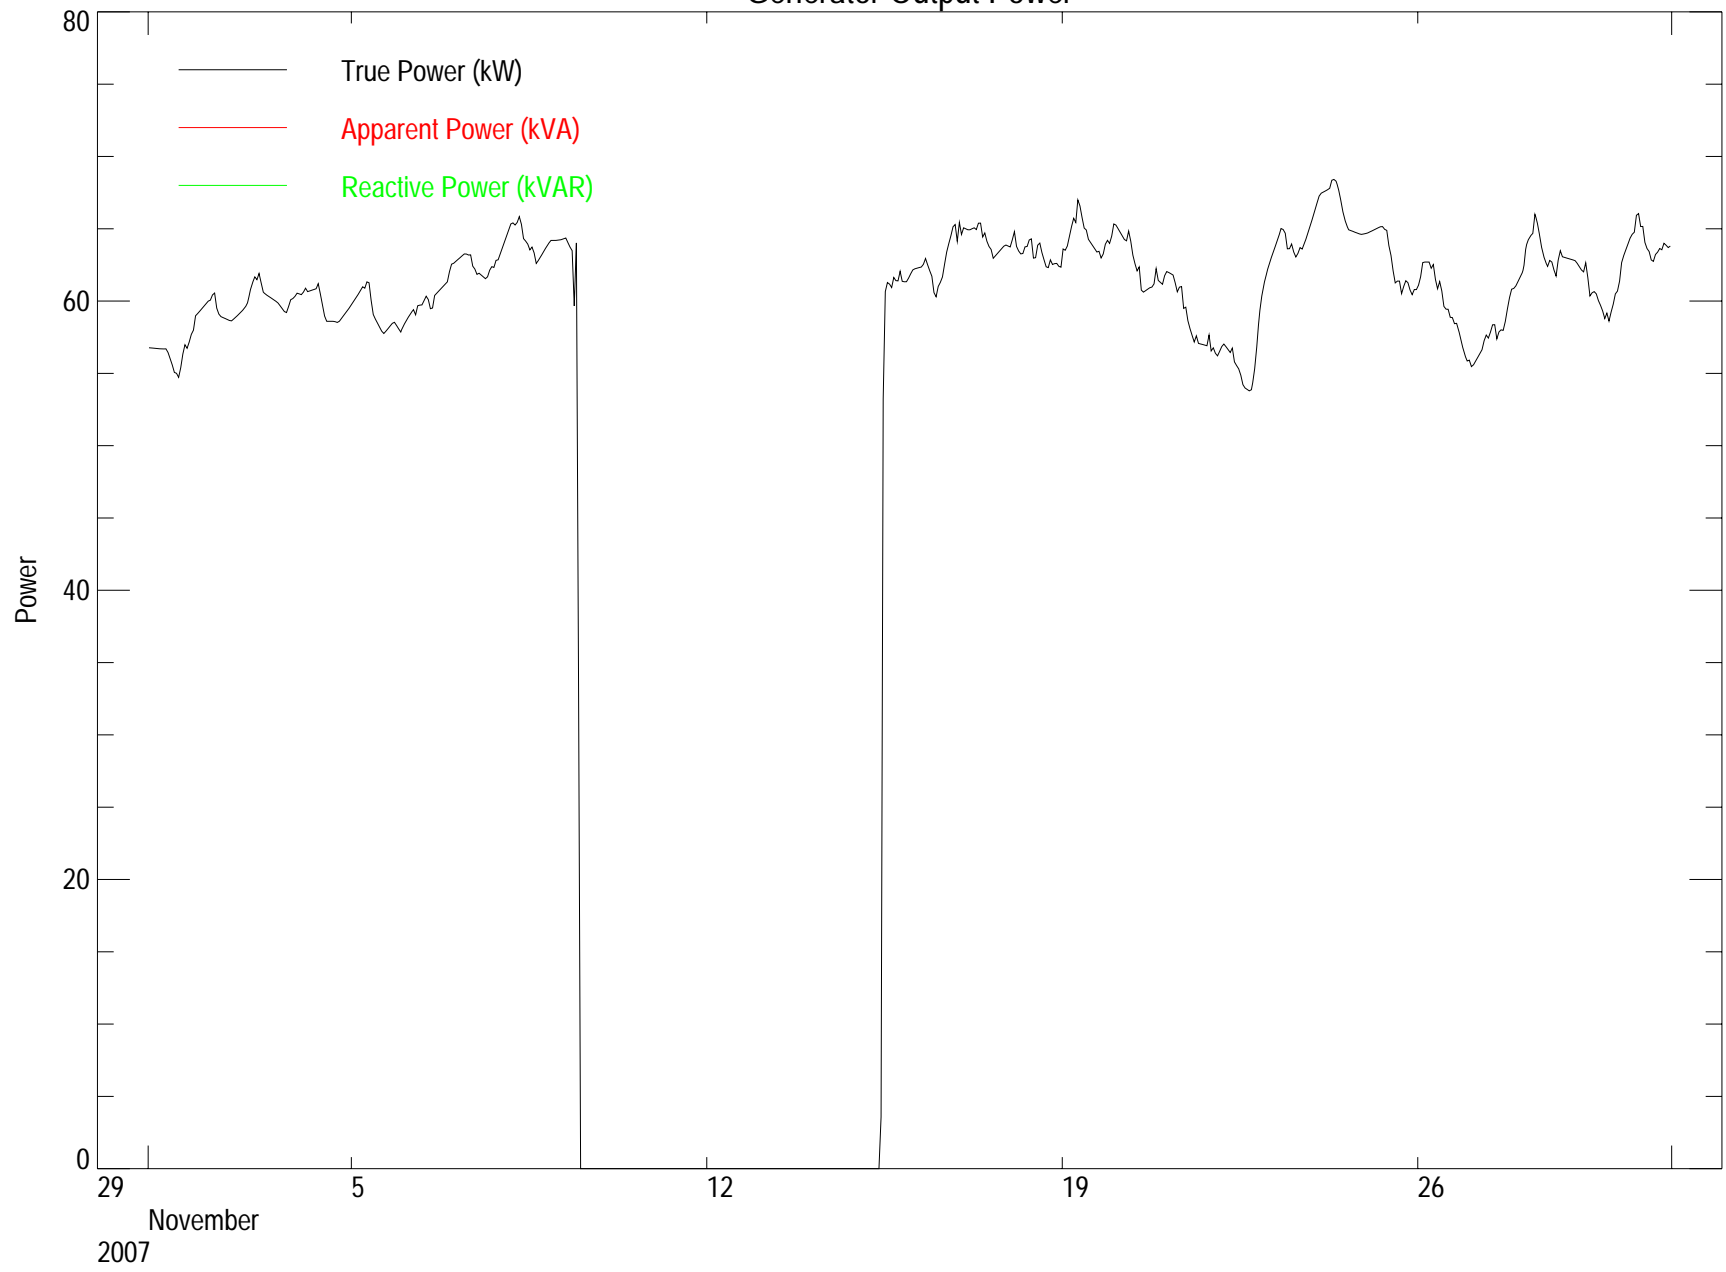

Generator Output Current

