

GENERATOR POWER QUALITY - DATA SUMMARY

Ten West 66th St. Corp.

03/01/08 to 03/31/08

	Line 1			Line 2			Line 3			Totals		
	Min	Avg	Max	Min	Avg	Max	Min	Avg	Max	Min	Avg	Max
Voltage (V)	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a
Current (amps)	85.52	93.56	103.86	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a
True Power (kW)	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	52.6	59.9	68.0
Apparent Power (kVA)	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a
Power Factor (-)	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a
Voltage THD (%)	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a
Current THD (%)	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a
Frequency (hz)	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a


GENERATOR POWER QUALITY - DATA SUMMARY

Ten West 66th St. Corp.

03/01/08 to 03/31/08

Date	Good Data (%)	Generator Apparent Power (kVAh)	Generator Reactive Power (kVARh)	Generator True Power (kWh)	Power Factor (-)
03/01/08	100.00	n/a	n/a	1515.73	n/a
03/02/08	100.00	n/a	n/a	1543.50	n/a
03/03/08	100.00	n/a	n/a	1426.75	n/a
03/04/08	100.00	n/a	n/a	1340.15	n/a
03/05/08	100.00	n/a	n/a	1374.63	n/a
03/06/08	100.00	n/a	n/a	1463.68	n/a
03/07/08	100.00	n/a	n/a	1454.35	n/a
03/08/08	100.00	n/a	n/a	1387.52	n/a
03/09/08	100.00	n/a	n/a	1530.67	n/a
03/10/08	100.00	n/a	n/a	1529.08	n/a
03/11/08	100.00	n/a	n/a	1463.58	n/a
03/12/08	100.00	n/a	n/a	1430.28	n/a
03/13/08	100.00	n/a	n/a	1464.49	n/a
03/14/08	100.00	n/a	n/a	1386.79	n/a
03/15/08	100.00	n/a	n/a	1381.48	n/a
03/16/08	100.00	n/a	n/a	1430.02	n/a
03/17/08	100.00	n/a	n/a	1476.55	n/a
03/18/08	100.00	n/a	n/a	1474.43	n/a
03/19/08	100.00	n/a	n/a	1396.63	n/a
03/20/08	100.00	n/a	n/a	1385.14	n/a
03/21/08	100.00	n/a	n/a	1475.55	n/a
03/22/08	100.00	n/a	n/a	1439.19	n/a
03/23/08	100.00	n/a	n/a	1461.26	n/a
03/24/08	100.00	n/a	n/a	1440.35	n/a
03/25/08	100.00	n/a	n/a	1466.15	n/a
03/26/08	100.00	n/a	n/a	1341.87	n/a
03/27/08	100.00	n/a	n/a	1365.10	n/a
03/28/08	100.00	n/a	n/a	1381.12	n/a
03/29/08	100.00	n/a	n/a	1451.31	n/a
03/30/08	100.00	n/a	n/a	1494.44	n/a
03/31/08	100.00	n/a	n/a	1393.50	n/a
Total	100.00	n/a	n/a	44565.29	n/a

Generator Output Power

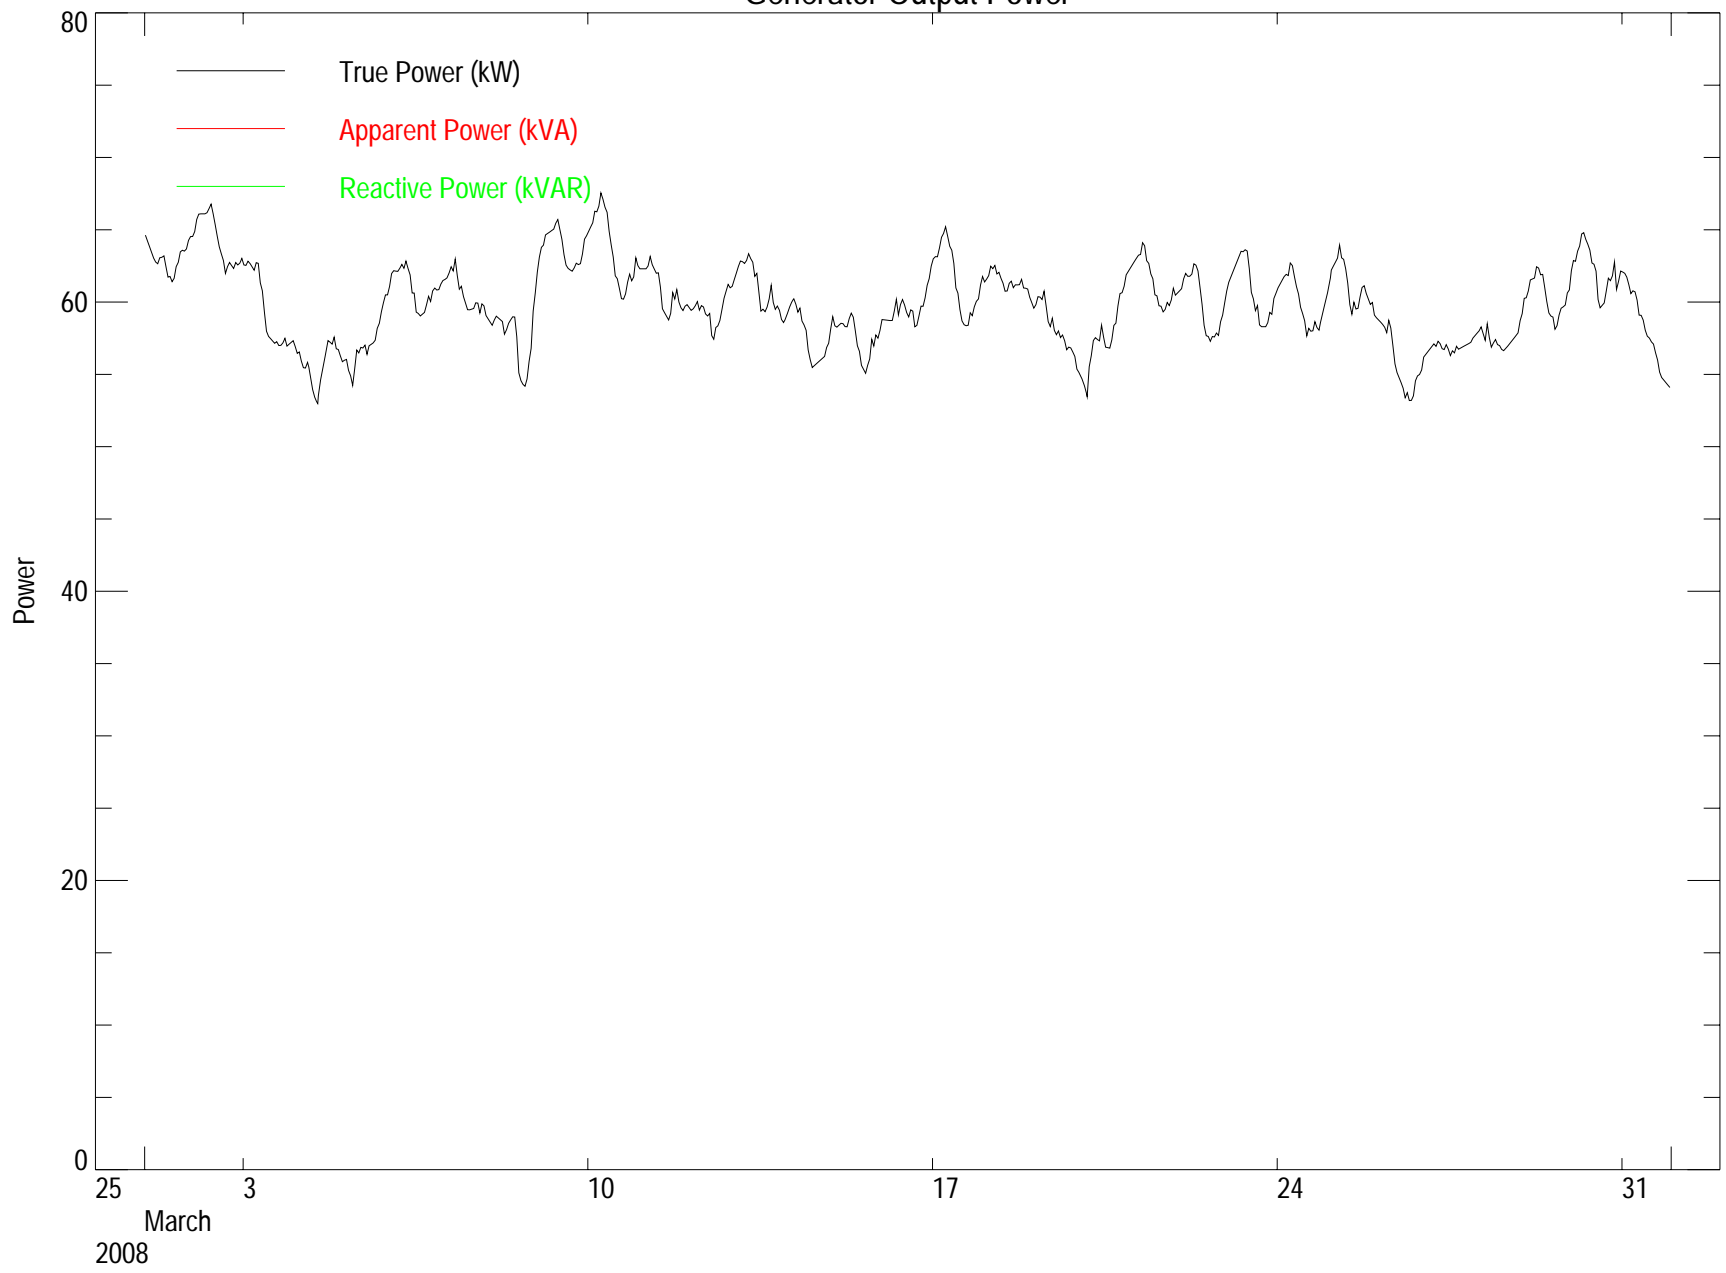

Generator Output Current

