

## GENERATOR POWER QUALITY - DATA SUMMARY

Ten West 66th St. Corp.

06/01/08 to 06/30/08

	Line 1			Line 2			Line 3			Totals		
	Min	Avg	Max	Min	Avg	Max	Min	Avg	Max	Min	Avg	Max
Voltage (V)	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a
Current (amps)	0.11	57.67	99.62	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a
True Power (kW)	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	0.3	39.0	60.7
Apparent Power (kVA)	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a
Power Factor (-)	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a
Voltage THD (%)	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a
Current THD (%)	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a
Frequency (hz)	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a


## GENERATOR POWER QUALITY - DATA SUMMARY

Ten West 66th St. Corp.

06/01/08 to 06/30/08

Date	Good Data (%)	Generator Apparent Power (kVAh)	Generator Reactive Power (kVARh)	Generator True Power (kWh)	Power Factor (-)
06/01/08	100.00	n/a	n/a	951.91	n/a
06/02/08	100.00	n/a	n/a	960.04	n/a
06/03/08	100.00	n/a	n/a	942.38	n/a
06/04/08	100.00	n/a	n/a	1009.86	n/a
06/05/08	100.00	n/a	n/a	1005.44	n/a
06/06/08	100.00	n/a	n/a	1027.66	n/a
06/07/08	100.00	n/a	n/a	202.13	n/a
06/08/08	100.00	n/a	n/a	514.97	n/a
06/09/08	100.00	n/a	n/a	0.00	n/a
06/10/08	100.00	n/a	n/a	688.15	n/a
06/11/08	100.00	n/a	n/a	915.93	n/a
06/12/08	100.00	n/a	n/a	77.49	n/a
06/13/08	100.00	n/a	n/a	520.88	n/a
06/14/08	100.00	n/a	n/a	0.00	n/a
06/15/08	100.00	n/a	n/a	0.00	n/a
06/16/08	100.00	n/a	n/a	744.85	n/a
06/17/08	100.00	n/a	n/a	941.75	n/a
06/18/08	100.00	n/a	n/a	960.18	n/a
06/19/08	100.00	n/a	n/a	946.09	n/a
06/20/08	100.00	n/a	n/a	926.96	n/a
06/21/08	100.00	n/a	n/a	918.53	n/a
06/22/08	100.00	n/a	n/a	913.85	n/a
06/23/08	100.00	n/a	n/a	899.50	n/a
06/24/08	100.00	n/a	n/a	900.78	n/a
06/25/08	100.00	n/a	n/a	898.12	n/a
06/26/08	100.00	n/a	n/a	578.44	n/a
06/27/08	100.00	n/a	n/a	0.00	n/a
06/28/08	100.00	n/a	n/a	0.00	n/a
06/29/08	100.00	n/a	n/a	0.00	n/a
06/30/08	100.00	n/a	n/a	0.00	n/a
Total	100.00	n/a	n/a	18445.89	n/a

# Generator Output Power

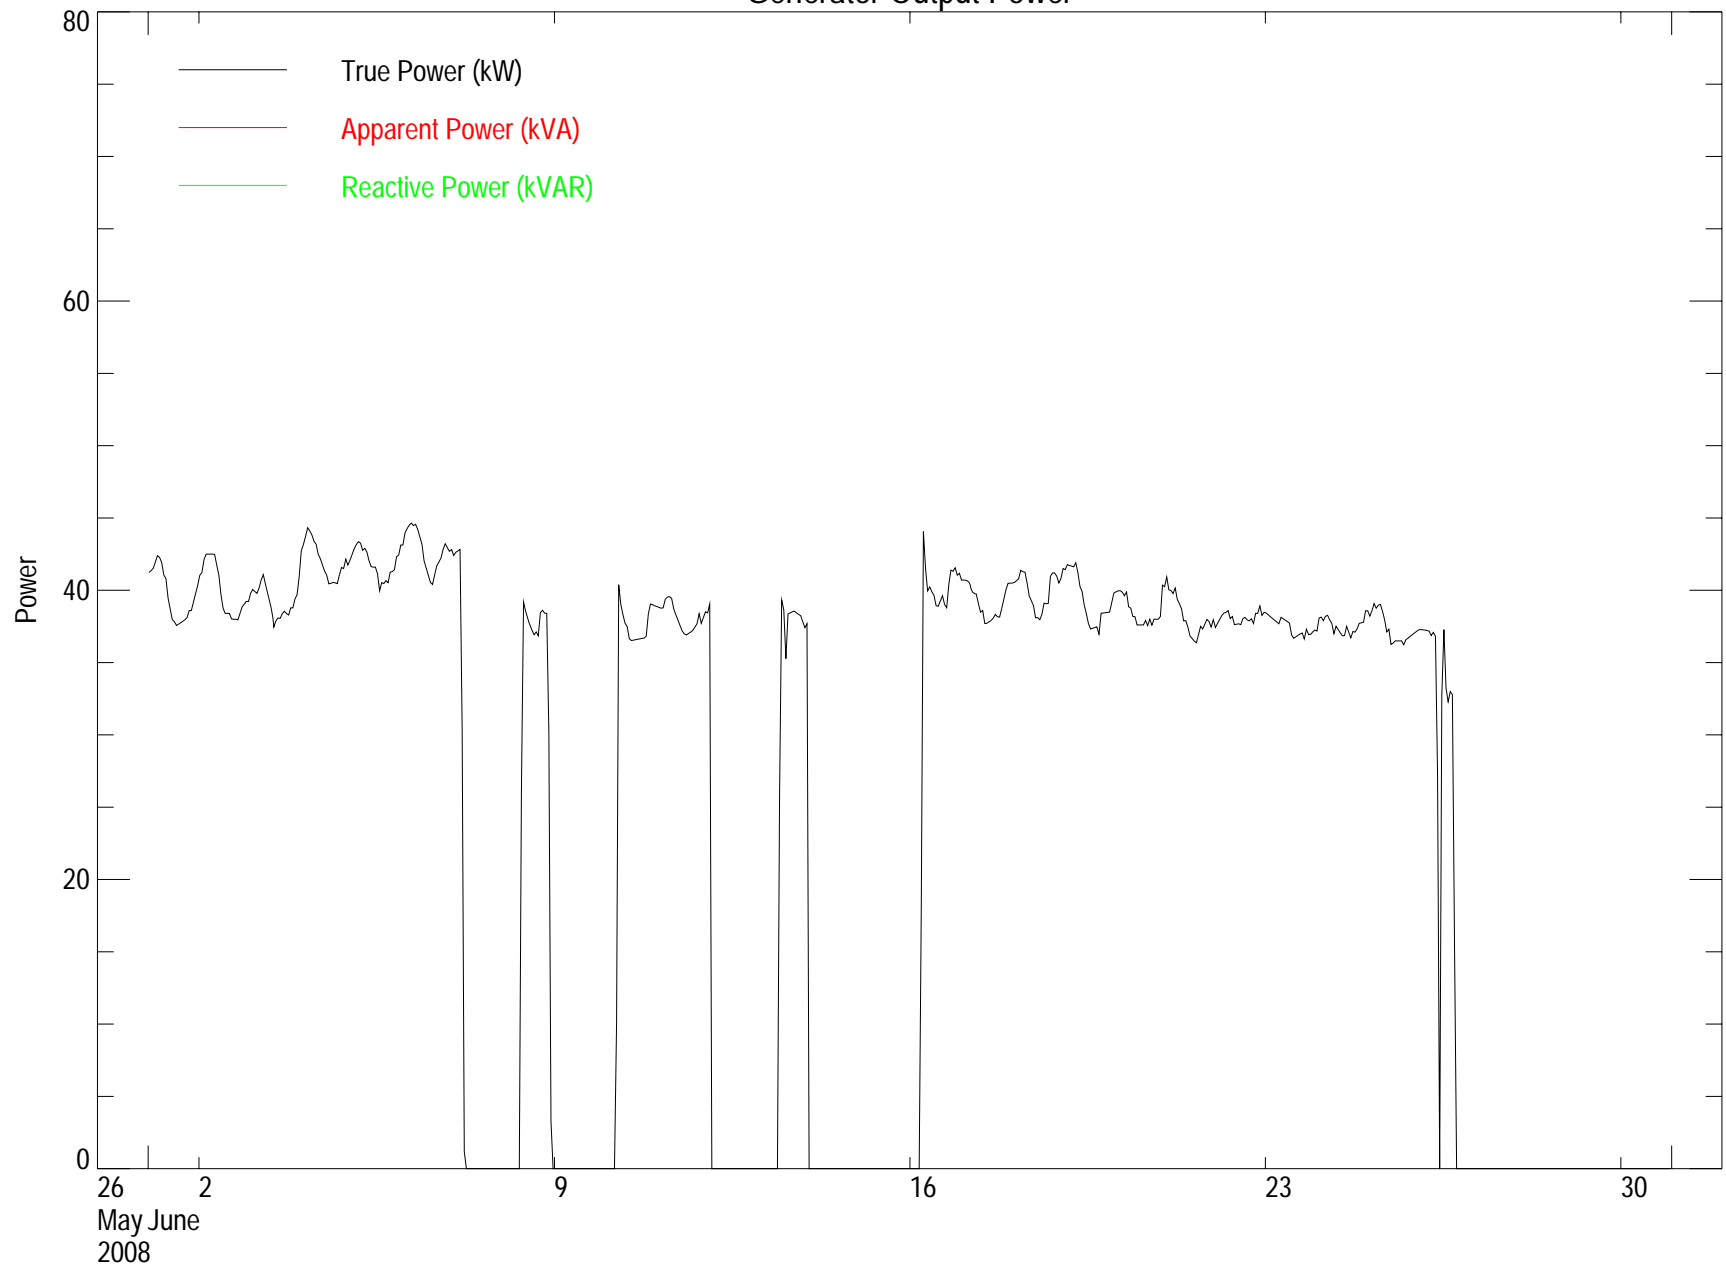

# Generator Output Current

