

## GENERATOR POWER QUALITY - DATA SUMMARY

Ten West 66th St. Corp.

07/01/08 to 07/31/08

	Line 1			Line 2			Line 3			Totals		
	Min	Avg	Max	Min	Avg	Max	Min	Avg	Max	Min	Avg	Max
Voltage (V)	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a
Current (amps)	0.01	43.72	97.83	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a
True Power (kW)	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	1.1	39.0	59.7
Apparent Power (kVA)	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a
Power Factor (-)	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a
Voltage THD (%)	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a
Current THD (%)	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a
Frequency (hz)	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a


## GENERATOR POWER QUALITY - DATA SUMMARY

Ten West 66th St. Corp.

07/01/08 to 07/31/08

Date	Good Data (%)	Generator Apparent Power (kVAh)	Generator Reactive Power (kVARh)	Generator True Power (kWh)	Power Factor (-)
07/01/08	100.00	n/a	n/a	0.00	n/a
07/02/08	100.00	n/a	n/a	377.51	n/a
07/03/08	100.00	n/a	n/a	0.00	n/a
07/04/08	100.00	n/a	n/a	0.00	n/a
07/05/08	100.00	n/a	n/a	0.00	n/a
07/06/08	100.00	n/a	n/a	574.83	n/a
07/07/08	100.00	n/a	n/a	0.00	n/a
07/08/08	100.00	n/a	n/a	266.43	n/a
07/09/08	100.00	n/a	n/a	288.69	n/a
07/10/08	100.00	n/a	n/a	57.33	n/a
07/11/08	100.00	n/a	n/a	0.00	n/a
07/12/08	100.00	n/a	n/a	0.00	n/a
07/13/08	100.00	n/a	n/a	380.02	n/a
07/14/08	100.00	n/a	n/a	507.46	n/a
07/15/08	100.00	n/a	n/a	972.98	n/a
07/16/08	100.00	n/a	n/a	965.11	n/a
07/17/08	100.00	n/a	n/a	951.42	n/a
07/18/08	100.00	n/a	n/a	653.70	n/a
07/19/08	100.00	n/a	n/a	417.52	n/a
07/20/08	100.00	n/a	n/a	43.36	n/a
07/21/08	100.00	n/a	n/a	452.30	n/a
07/22/08	100.00	n/a	n/a	403.54	n/a
07/23/08	100.00	n/a	n/a	955.45	n/a
07/24/08	100.00	n/a	n/a	954.27	n/a
07/25/08	100.00	n/a	n/a	937.00	n/a
07/26/08	100.00	n/a	n/a	83.57	n/a
07/27/08	100.00	n/a	n/a	461.51	n/a
07/28/08	100.00	n/a	n/a	964.94	n/a
07/29/08	100.00	n/a	n/a	795.33	n/a
07/30/08	100.00	n/a	n/a	931.38	n/a
07/31/08	100.00	n/a	n/a	910.34	n/a
Total	100.00	n/a	n/a	14305.97	n/a

# Generator Output Power

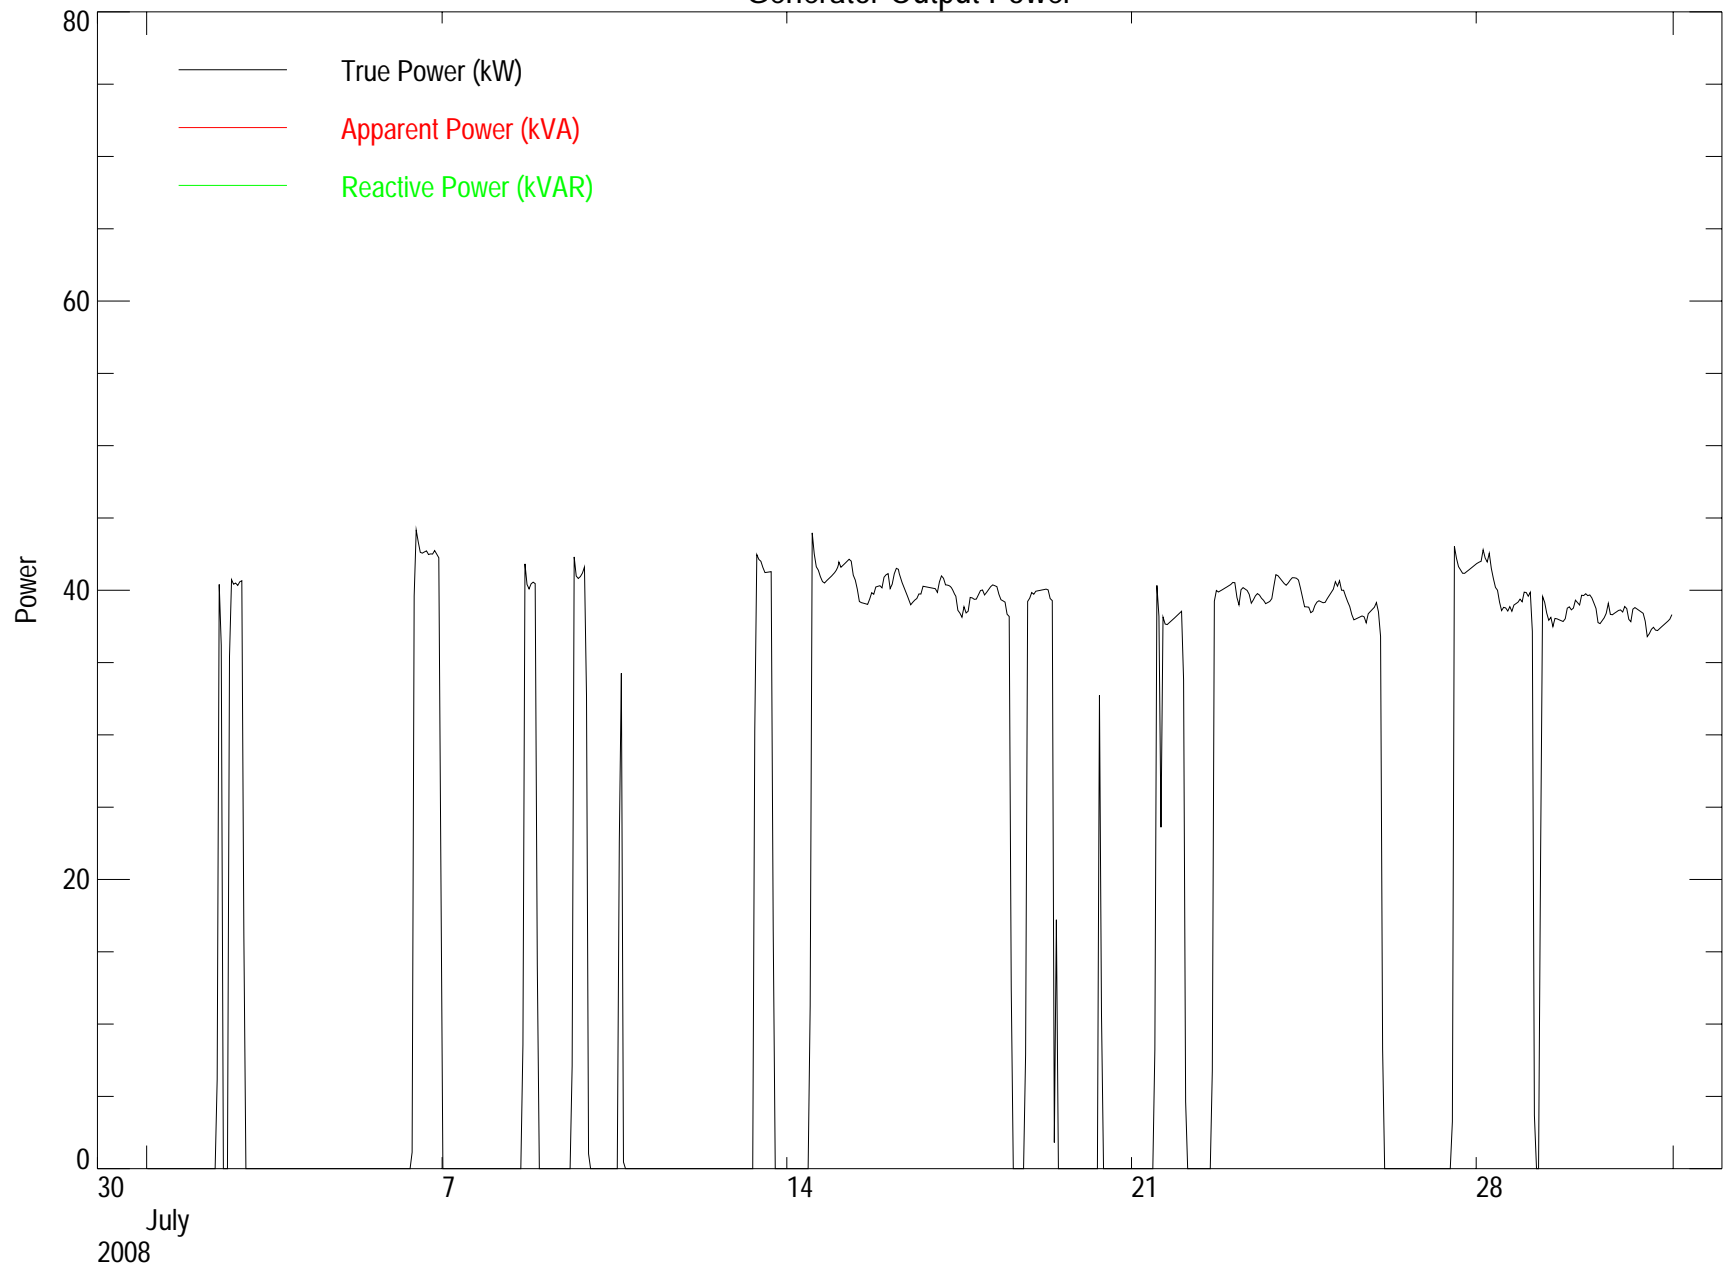

# Generator Output Current

