

GENERATOR POWER QUALITY - DATA SUMMARY

Ten West 66th St. Corp.

08/01/08 to 08/31/08

	Line 1			Line 2			Line 3			Totals		
	Min	Avg	Max	Min	Avg	Max	Min	Avg	Max	Min	Avg	Max
Voltage (V)	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a
Current (amps)	0.01	36.79	93.34	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a
True Power (kW)	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	0.3	40.1	58.8
Apparent Power (kVA)	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a
Power Factor (-)	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a
Voltage THD (%)	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a
Current THD (%)	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a
Frequency (hz)	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a


GENERATOR POWER QUALITY - DATA SUMMARY

Ten West 66th St. Corp.

08/01/08 to 08/31/08

Date	Good Data (%)	Generator Apparent Power (kVAh)	Generator Reactive Power (kVARh)	Generator True Power (kWh)	Power Factor (-)
08/01/08	100.00	n/a	n/a	909.09	n/a
08/02/08	100.00	n/a	n/a	937.72	n/a
08/03/08	100.00	n/a	n/a	940.98	n/a
08/04/08	100.00	n/a	n/a	934.71	n/a
08/05/08	100.00	n/a	n/a	939.15	n/a
08/06/08	100.00	n/a	n/a	924.97	n/a
08/07/08	100.00	n/a	n/a	707.96	n/a
08/08/08	100.00	n/a	n/a	945.99	n/a
08/09/08	100.00	n/a	n/a	134.66	n/a
08/10/08	100.00	n/a	n/a	666.03	n/a
08/11/08	100.00	n/a	n/a	1000.82	n/a
08/12/08	100.00	n/a	n/a	981.51	n/a
08/13/08	47.92	n/a	n/a	426.10	n/a
08/14/08	0.00	n/a	n/a	-	n/a
08/15/08	0.00	n/a	n/a	-	n/a
08/16/08	0.00	n/a	n/a	-	n/a
08/17/08	4.17	n/a	n/a	0.00	n/a
08/18/08	100.00	n/a	n/a	357.24	n/a
08/19/08	100.00	n/a	n/a	361.08	n/a
08/20/08	100.00	n/a	n/a	577.83	n/a
08/21/08	100.00	n/a	n/a	0.00	n/a
08/22/08	100.00	n/a	n/a	0.00	n/a
08/23/08	100.00	n/a	n/a	0.00	n/a
08/24/08	100.00	n/a	n/a	0.00	n/a
08/25/08	100.00	n/a	n/a	0.00	n/a
08/26/08	100.00	n/a	n/a	0.00	n/a
08/27/08	100.00	n/a	n/a	0.00	n/a
08/28/08	100.00	n/a	n/a	0.00	n/a
08/29/08	100.00	n/a	n/a	0.00	n/a
08/30/08	100.00	n/a	n/a	0.00	n/a
08/31/08	100.00	n/a	n/a	0.00	n/a
Total	85.55	n/a	n/a	11745.85	n/a

Generator Output Power

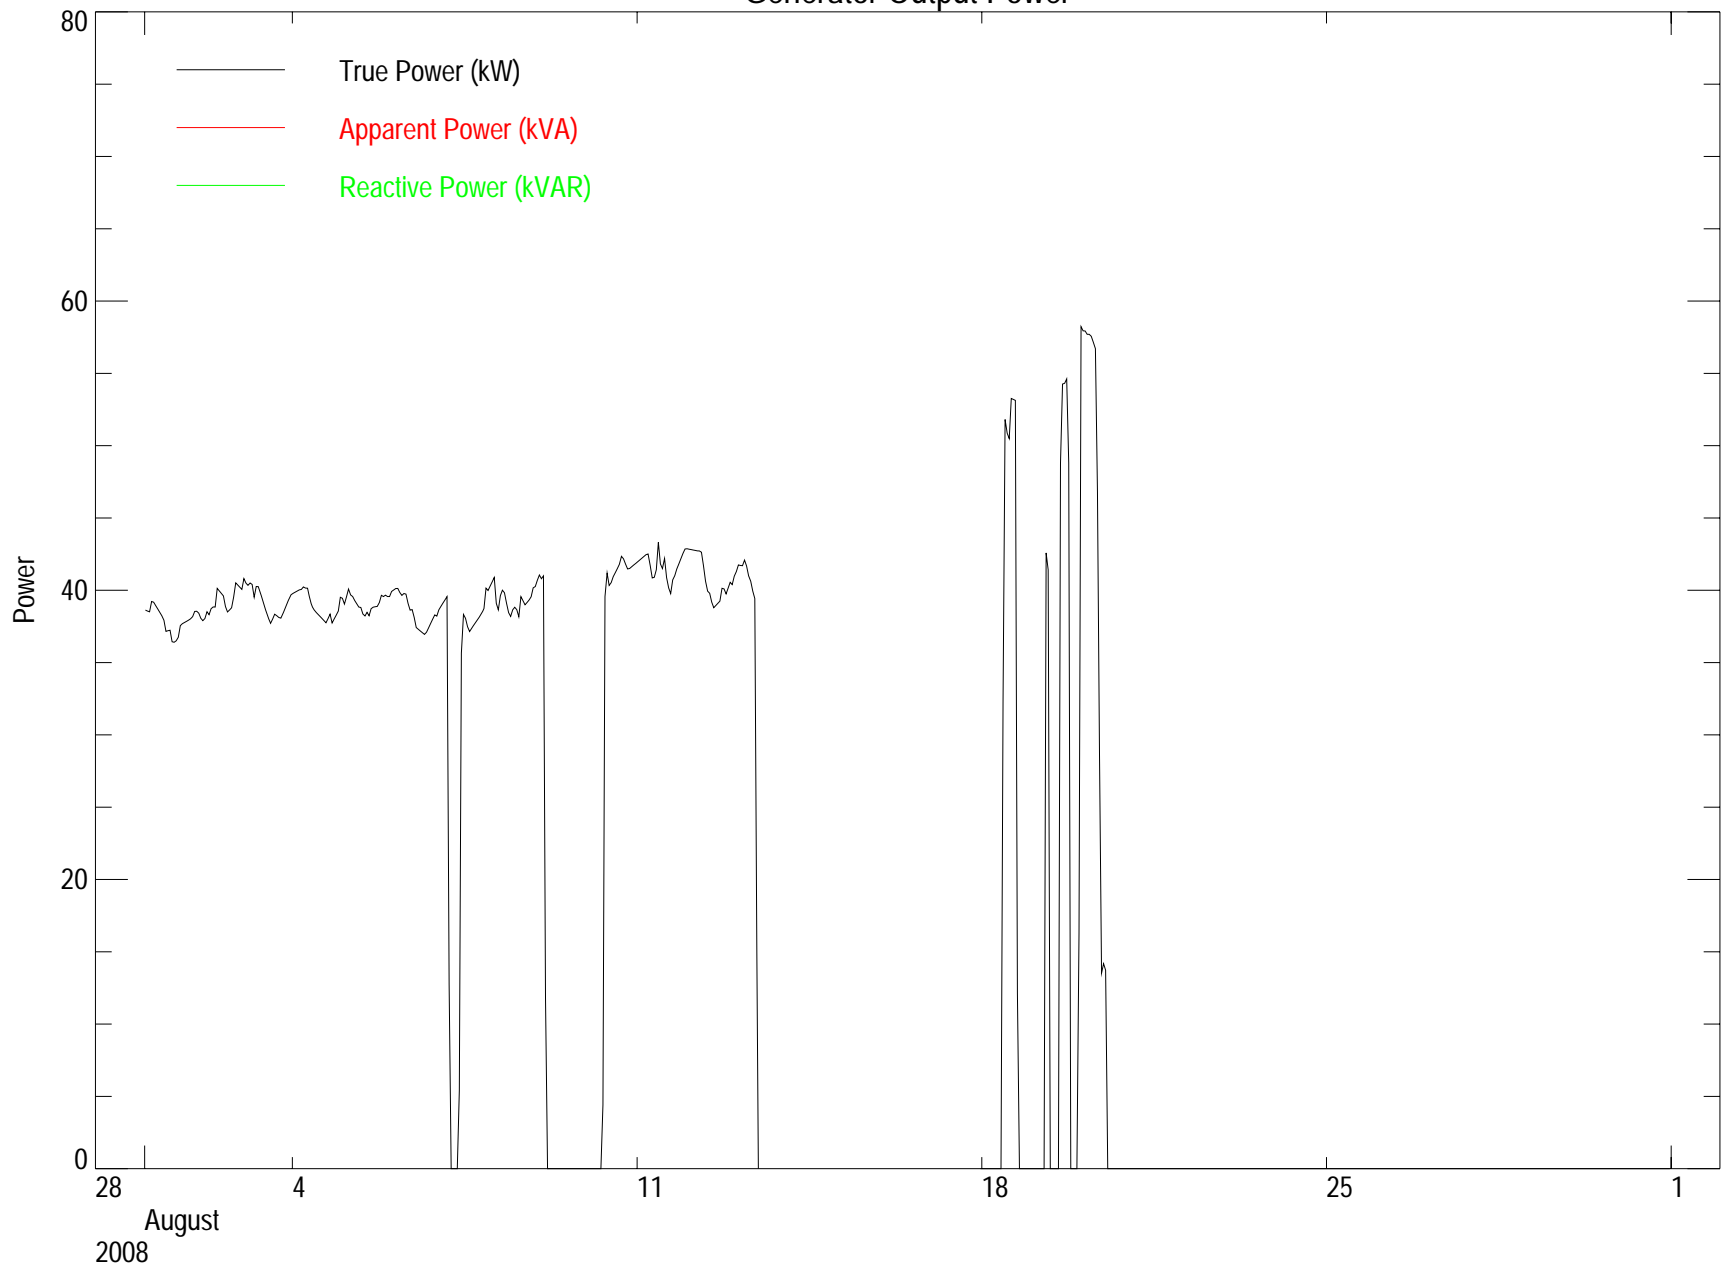

Generator Output Current

