

GENERATOR POWER QUALITY - DATA SUMMARY

Ten West 66th St. Corp.

09/01/08 to 09/30/08

	Line 1			Line 2			Line 3			Totals		
	Min	Avg	Max	Min	Avg	Max	Min	Avg	Max	Min	Avg	Max
Voltage (V)	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a
Current (amps)	0.01	1.74	89.80	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a
True Power (kW)	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	6.2	54.6	60.8
Apparent Power (kVA)	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a
Power Factor (-)	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a
Voltage THD (%)	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a
Current THD (%)	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a
Frequency (hz)	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a


GENERATOR POWER QUALITY - DATA SUMMARY

Ten West 66th St. Corp.

09/01/08 to 09/30/08

Date	Good Data (%)	Generator Apparent Power (kVAh)	Generator Reactive Power (kVARh)	Generator True Power (kWh)	Power Factor (-)
09/01/08	100.00	n/a	n/a	0.00	n/a
09/02/08	100.00	n/a	n/a	0.00	n/a
09/03/08	100.00	n/a	n/a	0.00	n/a
09/04/08	100.00	n/a	n/a	0.00	n/a
09/05/08	100.00	n/a	n/a	0.00	n/a
09/06/08	100.00	n/a	n/a	0.00	n/a
09/07/08	100.00	n/a	n/a	0.00	n/a
09/08/08	100.00	n/a	n/a	0.00	n/a
09/09/08	100.00	n/a	n/a	0.00	n/a
09/10/08	100.00	n/a	n/a	0.00	n/a
09/11/08	100.00	n/a	n/a	0.00	n/a
09/12/08	100.00	n/a	n/a	0.00	n/a
09/13/08	100.00	n/a	n/a	0.00	n/a
09/14/08	100.00	n/a	n/a	0.00	n/a
09/15/08	100.00	n/a	n/a	0.00	n/a
09/16/08	100.00	n/a	n/a	0.00	n/a
09/17/08	100.00	n/a	n/a	0.00	n/a
09/18/08	100.00	n/a	n/a	0.00	n/a
09/19/08	100.00	n/a	n/a	0.00	n/a
09/20/08	100.00	n/a	n/a	0.00	n/a
09/21/08	100.00	n/a	n/a	0.00	n/a
09/22/08	100.00	n/a	n/a	0.00	n/a
09/23/08	100.00	n/a	n/a	0.00	n/a
09/24/08	100.00	n/a	n/a	0.00	n/a
09/25/08	100.00	n/a	n/a	0.00	n/a
09/26/08	100.00	n/a	n/a	0.00	n/a
09/27/08	100.00	n/a	n/a	0.00	n/a
09/28/08	100.00	n/a	n/a	0.00	n/a
09/29/08	100.00	n/a	n/a	0.00	n/a
09/30/08	100.00	n/a	n/a	695.80	n/a
Total	100.00	n/a	n/a	695.80	n/a

Generator Output Power

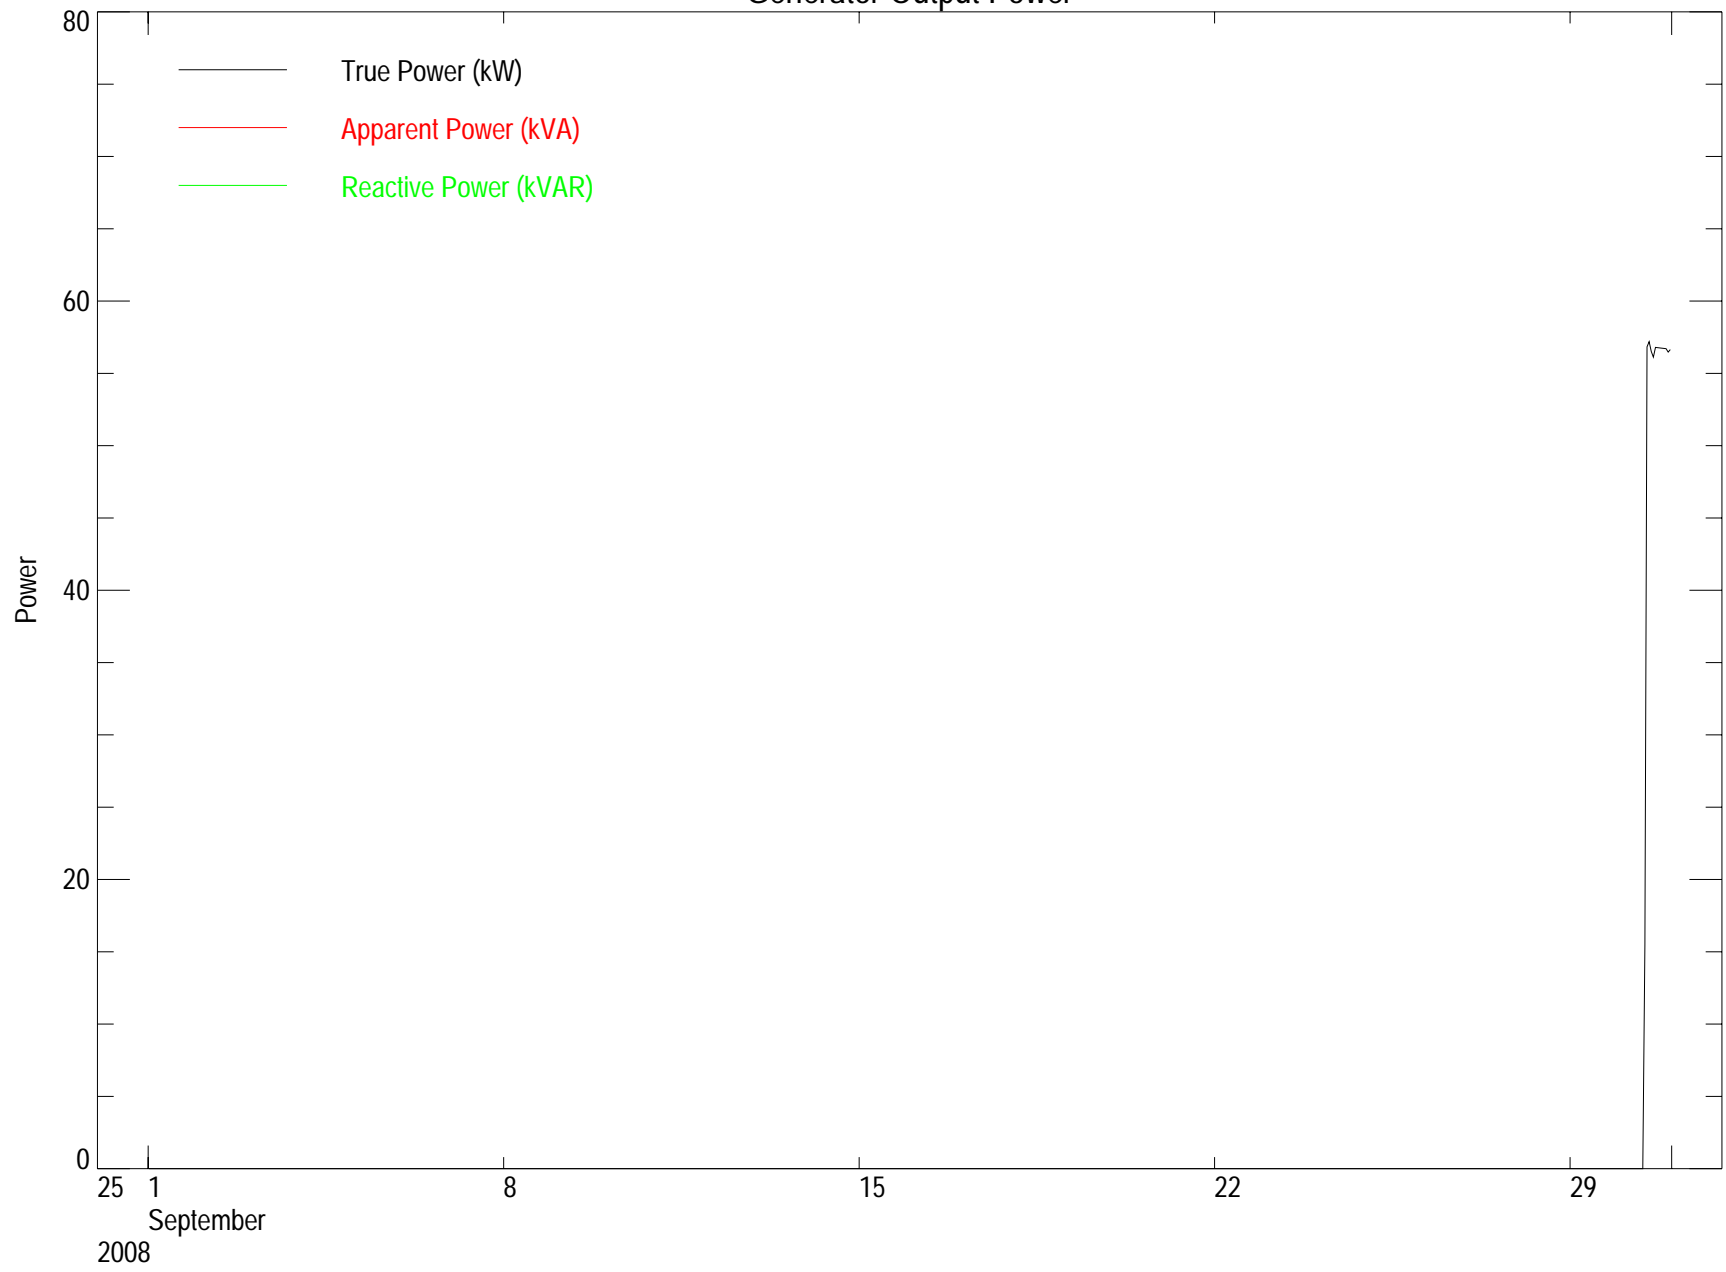

Generator Output Current

