GENERATOR POWER QUALITY - DATA SUMMARY

Ten West 66th St. Corp.

10/01/08 to 10/31/08

	Line 1			Line 2			Line 3			Totals		
	Min	Avg	Max	Min	Avg	Max	Min	Avg	Max	Min	Avg	Max
Voltage (V)	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a
Current (amps)	0.10	17.11	94.74	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a
True Power (kW)	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	2.5	56.3	65.2
Apparent Power (kVA)	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a
Power Factor (-)	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a
Voltage THD (%)	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a
Current THD (%)	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a
Frequency (hz)	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a

Report Generated on Nov 07, 2008 04:56 AM

GENERATOR POWER QUALITY - DATA SUMMARY

Ten West 66th St. Corp.

10/01/08 to 10/31/08

Date	Good Data (%)	Generator Apparent Power (kVAh)	Generator Reactive Power (kVARh)	Generator True Power (kWh)	Power Factor (-)
10/01/08	100.00	n/a	n/a	415.07	n/a
10/02/08	100.00	n/a	n/a	0.00	n/a
10/03/08	100.00	n/a	n/a	395.77	n/a
10/04/08	100.00	n/a	n/a	0.00	n/a
10/05/08	100.00	n/a	n/a	925.42	n/a
10/06/08	100.00	n/a	n/a	998.62	n/a
10/07/08	100.00	n/a	n/a	51.95	n/a
10/08/08	100.00	n/a	n/a	320.64	n/a
10/09/08	100.00	n/a	n/a	51.51	n/a
10/10/08	100.00	n/a	n/a	0.00	n/a
10/11/08	100.00	n/a	n/a	0.00	n/a
10/12/08	100.00	n/a	n/a	840.89	n/a
10/13/08	100.00	n/a	n/a	267.50	n/a
10/14/08	100.00	n/a	n/a	0.00	n/a
10/15/08	100.00	n/a	n/a	548.83	n/a
10/16/08	100.00	n/a	n/a	978.88	n/a
10/17/08	100.00	n/a	n/a	0.00	n/a
10/18/08	100.00	n/a	n/a	0.00	n/a
10/19/08	100.00	n/a	n/a	0.00	n/a
10/20/08	100.00	n/a	n/a	0.00	n/a
10/21/08	100.00	n/a	n/a	0.00	n/a
10/22/08	100.00	n/a	n/a	0.00	n/a
10/23/08	100.00	n/a	n/a	0.00	n/a
10/24/08	100.00	n/a	n/a	0.00	n/a
10/25/08	100.00	n/a	n/a	0.00	n/a
10/26/08	96.88	n/a	n/a	0.00	n/a
10/27/08	100.00	n/a	n/a	0.00	n/a
10/28/08	100.00	n/a	n/a	0.00	n/a
10/29/08	100.00	n/a	n/a	0.00	n/a
10/30/08	100.00	n/a	n/a	0.00	n/a
10/31/08	100.00	n/a	n/a	0.00	n/a
Total	99.90	n/a	n/a	5795.09	n/a

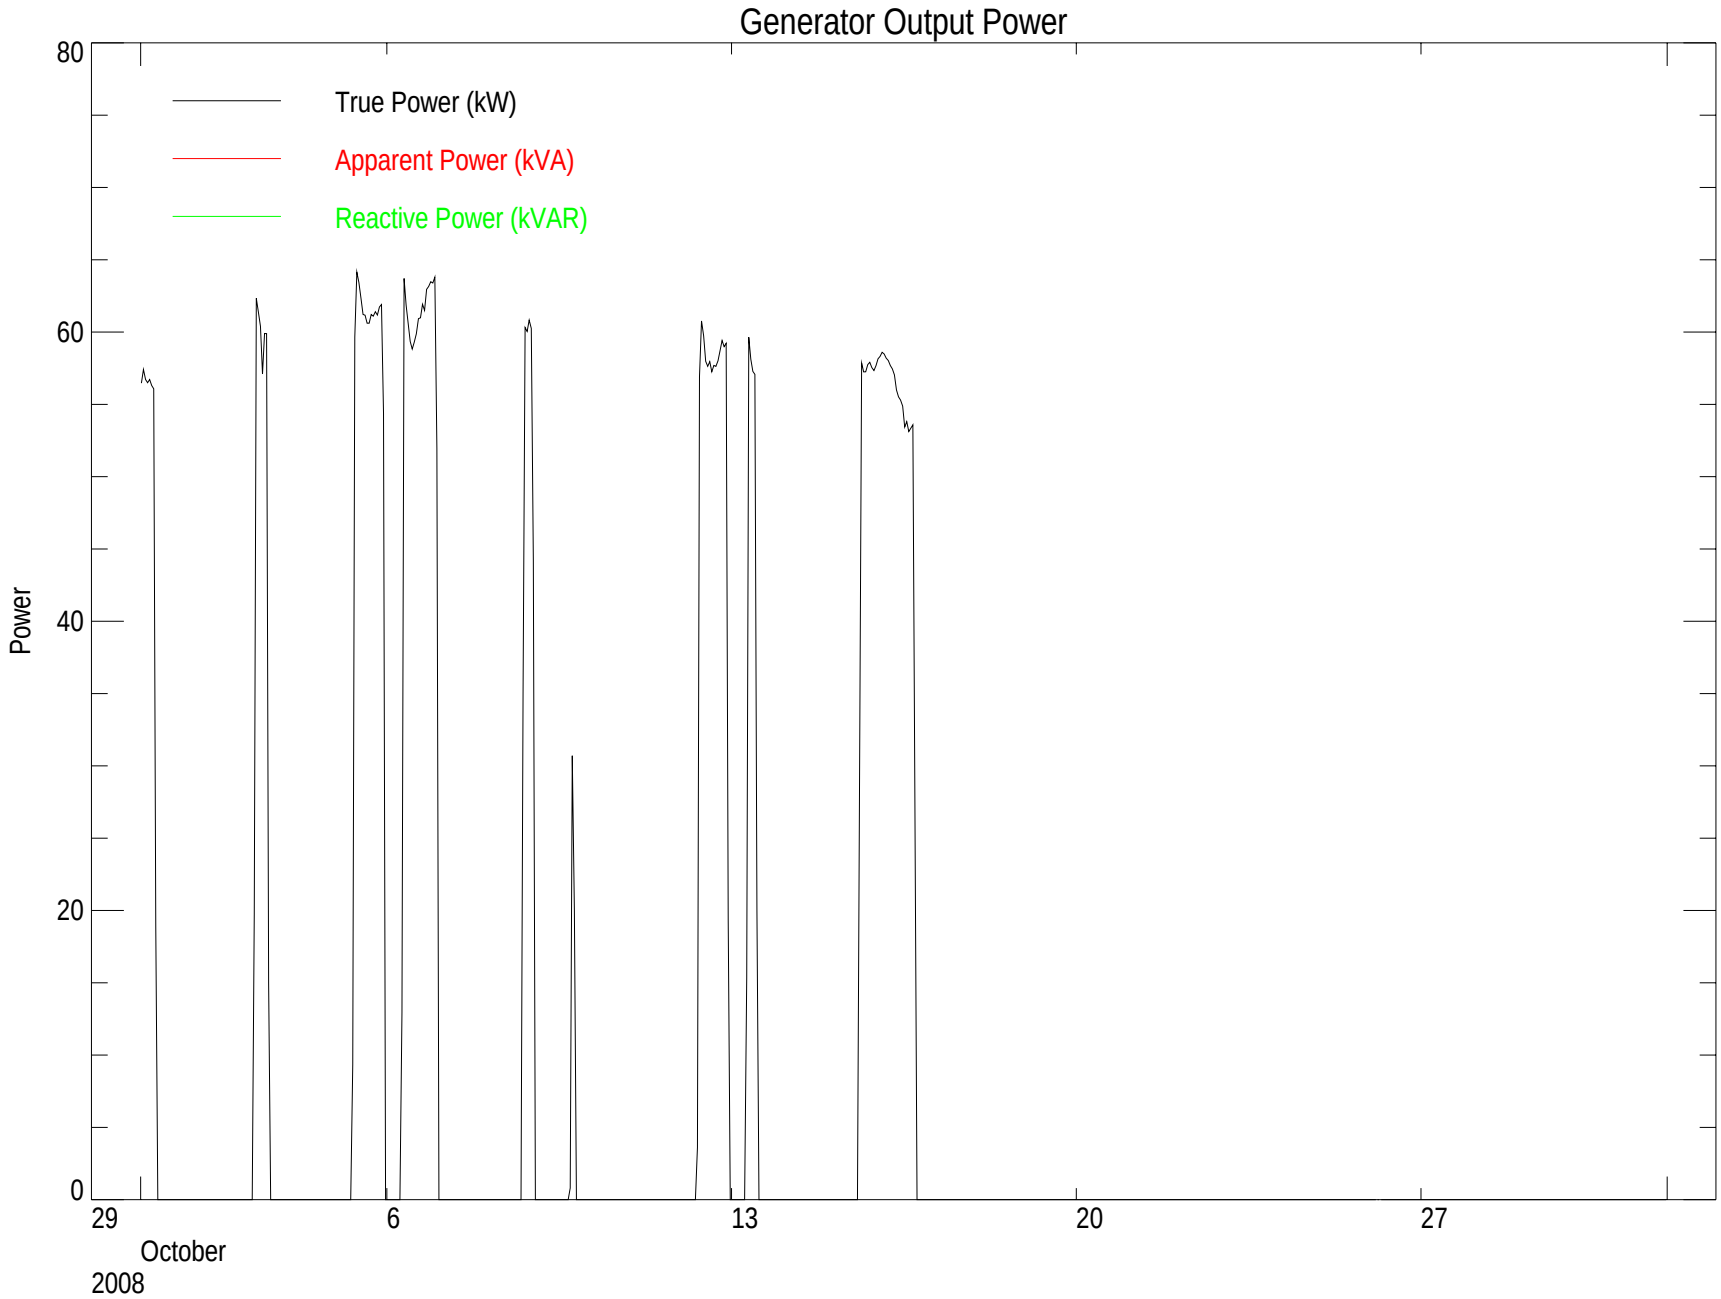
Generator Output Power
True Power (kW)
Apparent Power (kVA)
Reactive Power (kVAR)
Power
80
60
40
20
0
29
6
13
20
27
October
2008

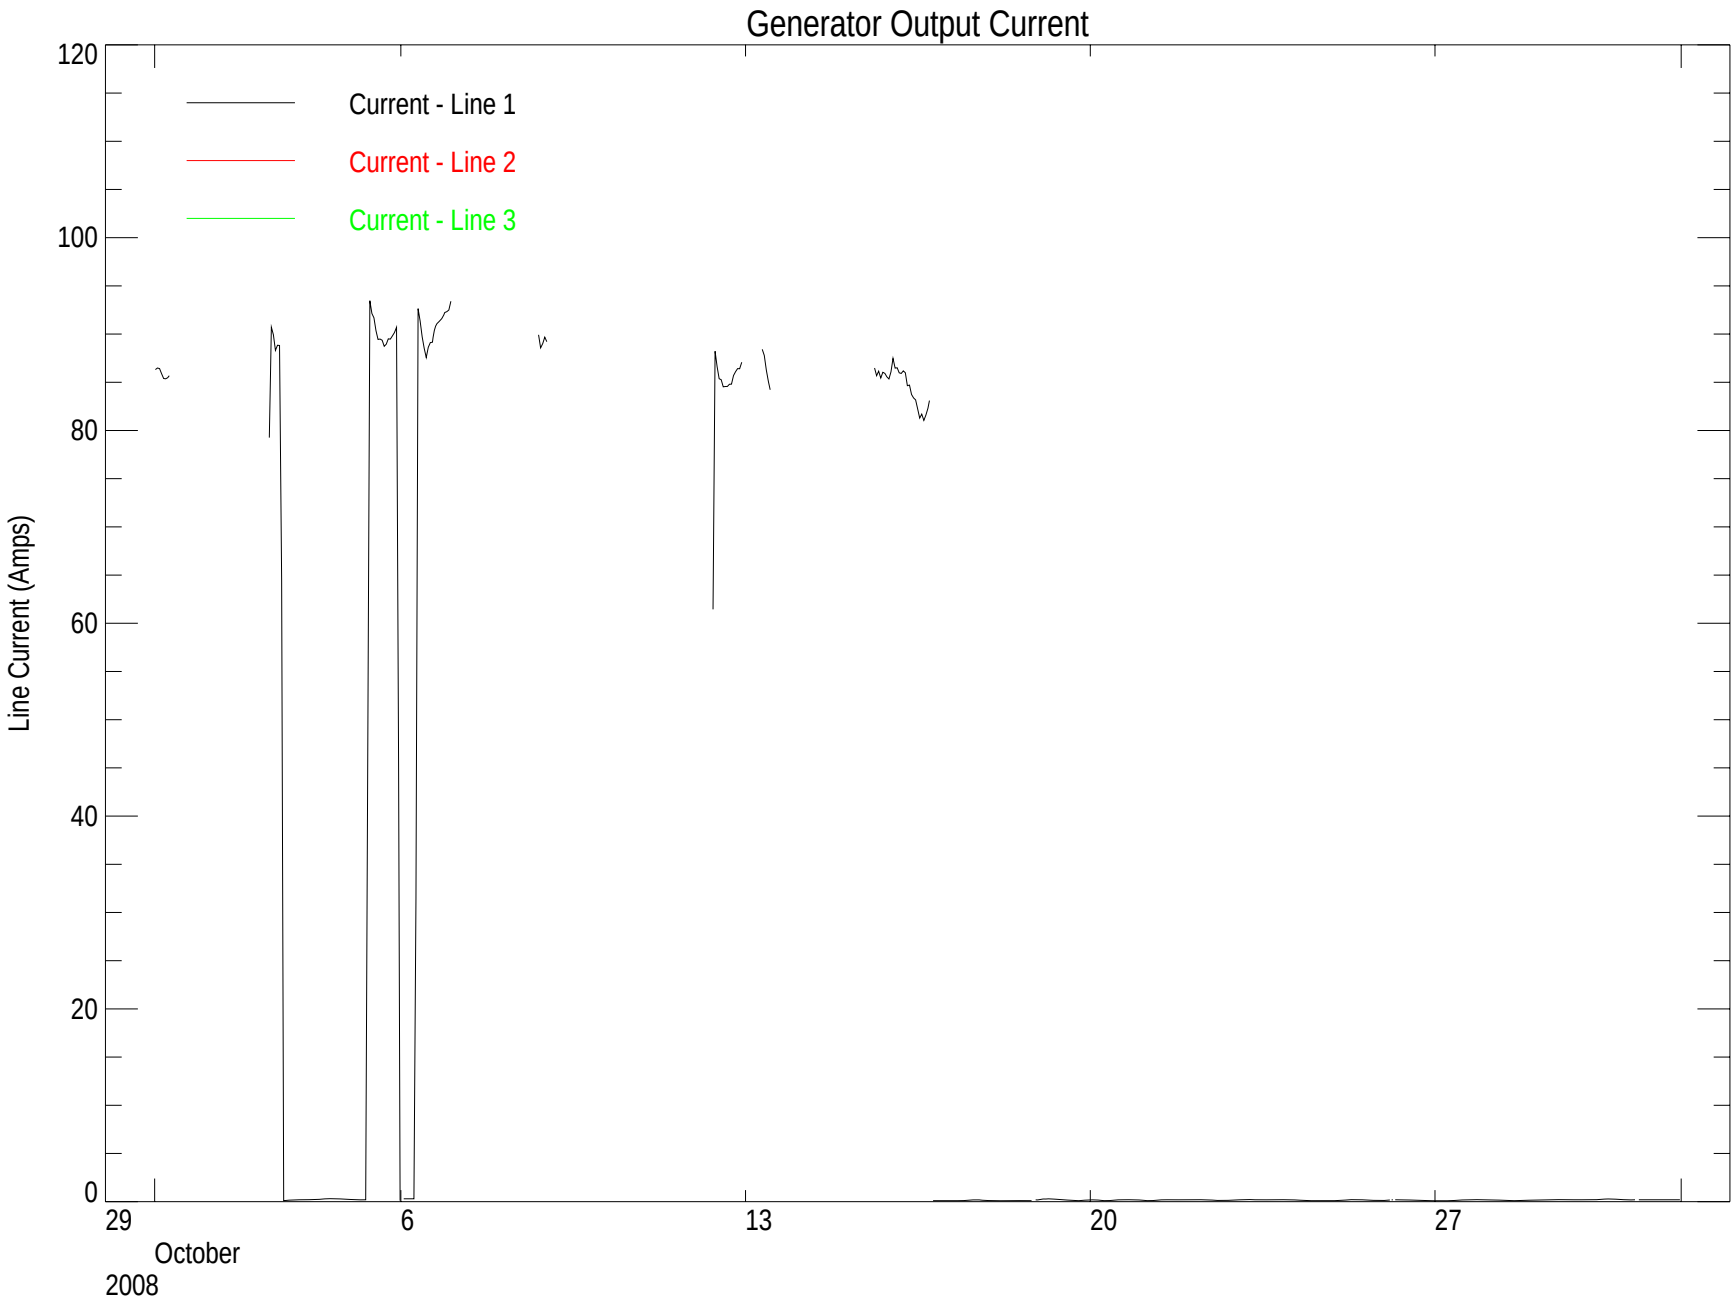
Generator Output Current
Current - Line 1
Current - Line 2
Current - Line 3
Line Current (Amps)
120
100
80
60
40
20
0
29
6
13
20
27
October
2008