

GENERATOR POWER QUALITY - DATA SUMMARY

Ten West 66th St. Corp.

12/01/08 to 12/31/08

	Line 1			Line 2			Line 3			Totals		
	Min	Avg	Max	Min	Avg	Max	Min	Avg	Max	Min	Avg	Max
Voltage (V)	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a
Current (amps)	0.10	0.22	0.30	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a
True Power (kW)	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	-	-	-
Apparent Power (kVA)	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a
Power Factor (-)	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a
Voltage THD (%)	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a
Current THD (%)	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a
Frequency (hz)	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a


GENERATOR POWER QUALITY - DATA SUMMARY

Ten West 66th St. Corp.

12/01/08 to 12/31/08

Date	Good Data (%)	Generator Apparent Power (kVAh)	Generator Reactive Power (kVARh)	Generator True Power (kWh)	Power Factor (-)
12/01/08	100.00	n/a	n/a	0.00	n/a
12/02/08	100.00	n/a	n/a	0.00	n/a
12/03/08	100.00	n/a	n/a	0.00	n/a
12/04/08	100.00	n/a	n/a	0.00	n/a
12/05/08	100.00	n/a	n/a	0.00	n/a
12/06/08	100.00	n/a	n/a	0.00	n/a
12/07/08	100.00	n/a	n/a	0.00	n/a
12/08/08	100.00	n/a	n/a	0.00	n/a
12/09/08	100.00	n/a	n/a	0.00	n/a
12/10/08	100.00	n/a	n/a	0.00	n/a
12/11/08	100.00	n/a	n/a	0.00	n/a
12/12/08	100.00	n/a	n/a	0.00	n/a
12/13/08	100.00	n/a	n/a	0.00	n/a
12/14/08	100.00	n/a	n/a	0.00	n/a
12/15/08	100.00	n/a	n/a	0.00	n/a
12/16/08	100.00	n/a	n/a	0.00	n/a
12/17/08	100.00	n/a	n/a	0.00	n/a
12/18/08	100.00	n/a	n/a	0.00	n/a
12/19/08	100.00	n/a	n/a	0.00	n/a
12/20/08	100.00	n/a	n/a	0.00	n/a
12/21/08	100.00	n/a	n/a	0.00	n/a
12/22/08	100.00	n/a	n/a	0.00	n/a
12/23/08	100.00	n/a	n/a	0.00	n/a
12/24/08	100.00	n/a	n/a	0.00	n/a
12/25/08	100.00	n/a	n/a	0.00	n/a
12/26/08	100.00	n/a	n/a	0.00	n/a
12/27/08	100.00	n/a	n/a	0.00	n/a
12/28/08	100.00	n/a	n/a	0.00	n/a
12/29/08	100.00	n/a	n/a	0.00	n/a
12/30/08	100.00	n/a	n/a	0.00	n/a
12/31/08	100.00	n/a	n/a	0.00	n/a
Total	100.00	n/a	n/a	0.00	n/a

Generator Output Power

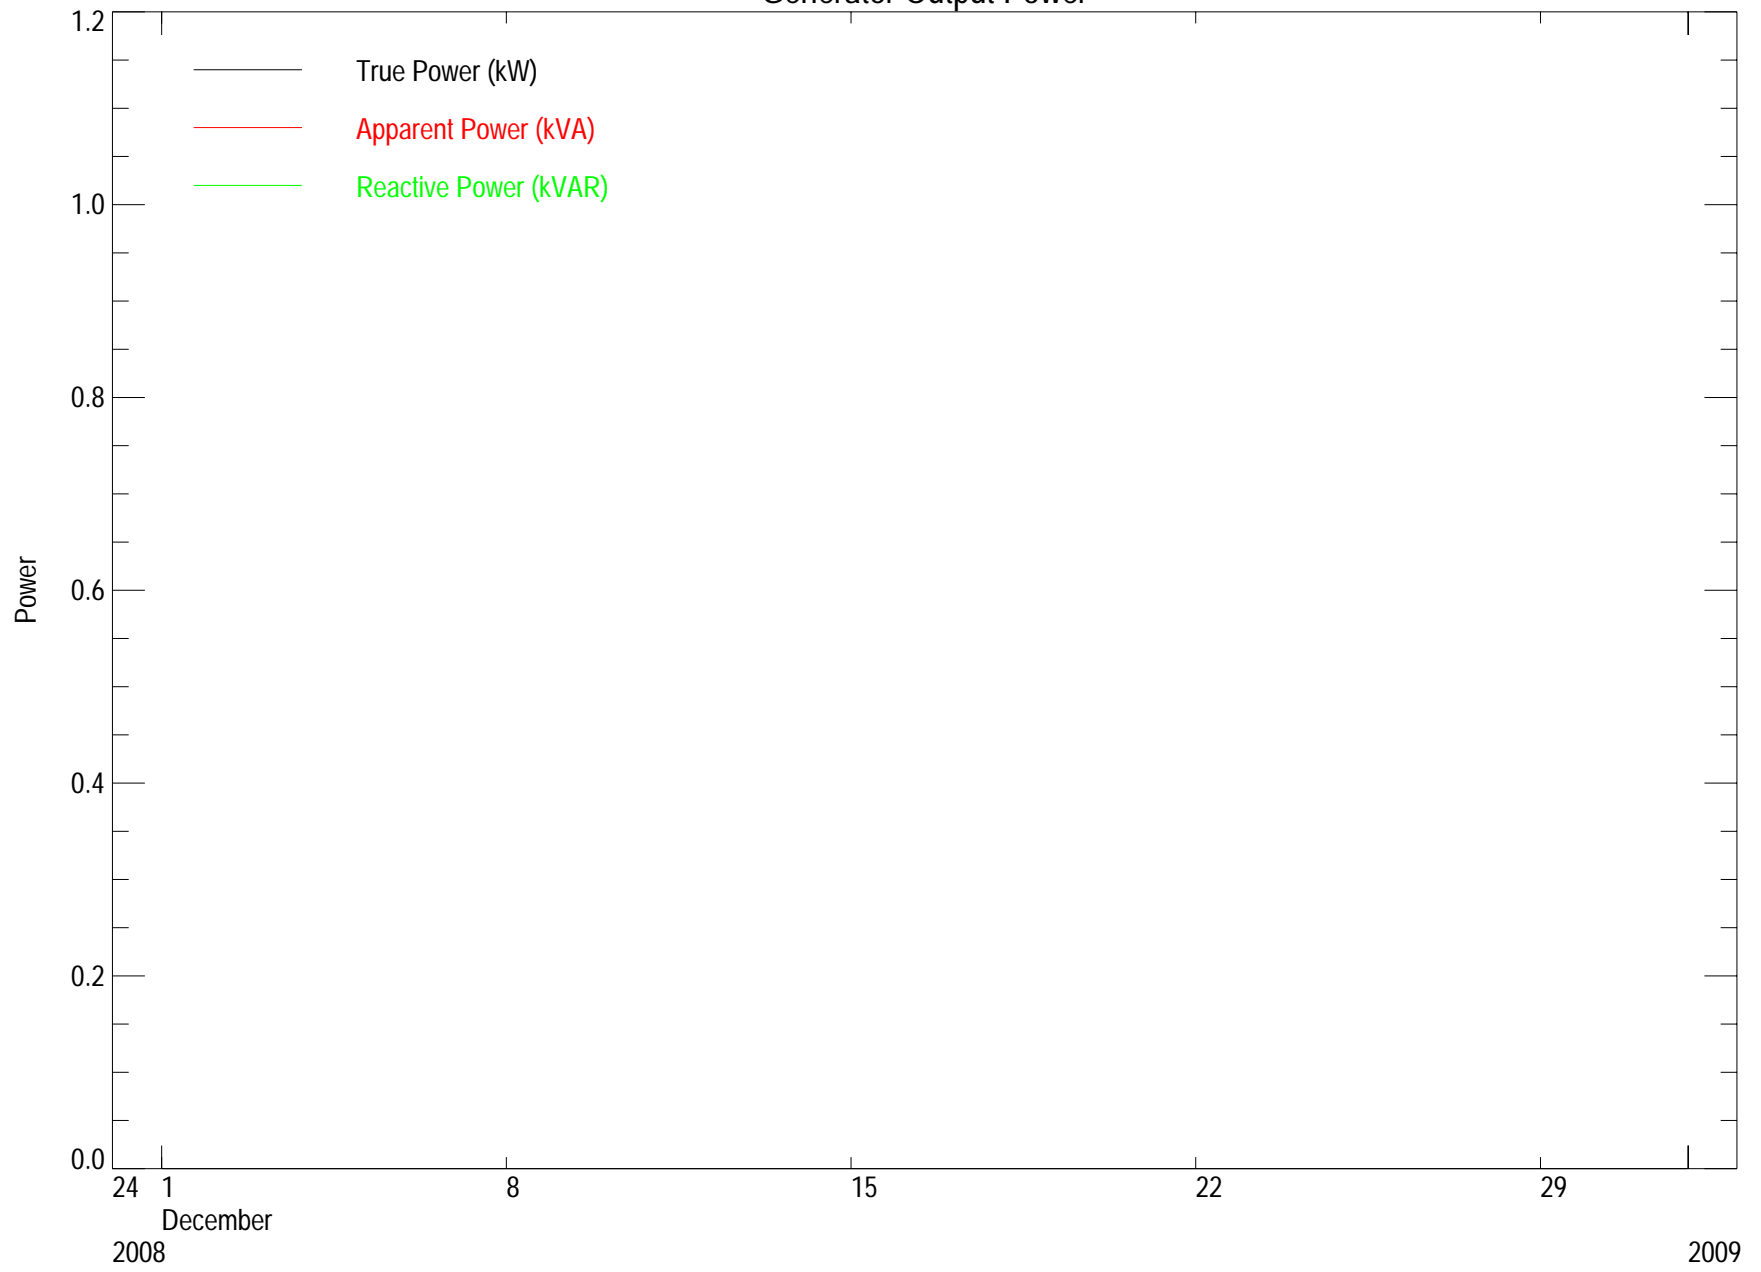

Generator Output Current

