

GENERATOR POWER QUALITY - DATA SUMMARY

Ten West 66th St. Corp.

02/01/09 to 02/28/09

	Line 1			Line 2			Line 3			Totals		
	Min	Avg	Max	Min	Avg	Max	Min	Avg	Max	Min	Avg	Max
Voltage (V)	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a
Current (amps)	0.20	0.42	0.79	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a
True Power (kW)	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	-	-	-
Apparent Power (kVA)	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a
Power Factor (-)	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a
Voltage THD (%)	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a
Current THD (%)	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a
Frequency (hz)	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a


GENERATOR POWER QUALITY - DATA SUMMARY

Ten West 66th St. Corp.

02/01/09 to 02/28/09

Date	Good Data (%)	Generator Apparent Power (kVAh)	Generator Reactive Power (kVARh)	Generator True Power (kWh)	Power Factor (-)
02/01/09	100.00	n/a	n/a	0.00	n/a
02/02/09	100.00	n/a	n/a	0.00	n/a
02/03/09	100.00	n/a	n/a	0.00	n/a
02/04/09	100.00	n/a	n/a	0.00	n/a
02/05/09	100.00	n/a	n/a	0.00	n/a
02/06/09	100.00	n/a	n/a	0.00	n/a
02/07/09	100.00	n/a	n/a	0.00	n/a
02/08/09	100.00	n/a	n/a	0.00	n/a
02/09/09	100.00	n/a	n/a	0.00	n/a
02/10/09	100.00	n/a	n/a	0.00	n/a
02/11/09	100.00	n/a	n/a	0.00	n/a
02/12/09	100.00	n/a	n/a	0.00	n/a
02/13/09	100.00	n/a	n/a	0.00	n/a
02/14/09	100.00	n/a	n/a	0.00	n/a
02/15/09	100.00	n/a	n/a	0.00	n/a
02/16/09	100.00	n/a	n/a	0.00	n/a
02/17/09	100.00	n/a	n/a	0.00	n/a
02/18/09	100.00	n/a	n/a	0.00	n/a
02/19/09	100.00	n/a	n/a	0.00	n/a
02/20/09	100.00	n/a	n/a	0.00	n/a
02/21/09	100.00	n/a	n/a	0.00	n/a
02/22/09	100.00	n/a	n/a	0.00	n/a
02/23/09	100.00	n/a	n/a	0.00	n/a
02/24/09	100.00	n/a	n/a	0.00	n/a
02/25/09	100.00	n/a	n/a	0.00	n/a
02/26/09	100.00	n/a	n/a	0.00	n/a
02/27/09	100.00	n/a	n/a	0.00	n/a
02/28/09	100.00	n/a	n/a	0.00	n/a
Total	100.00	n/a	n/a	0.00	n/a

Generator Output Power

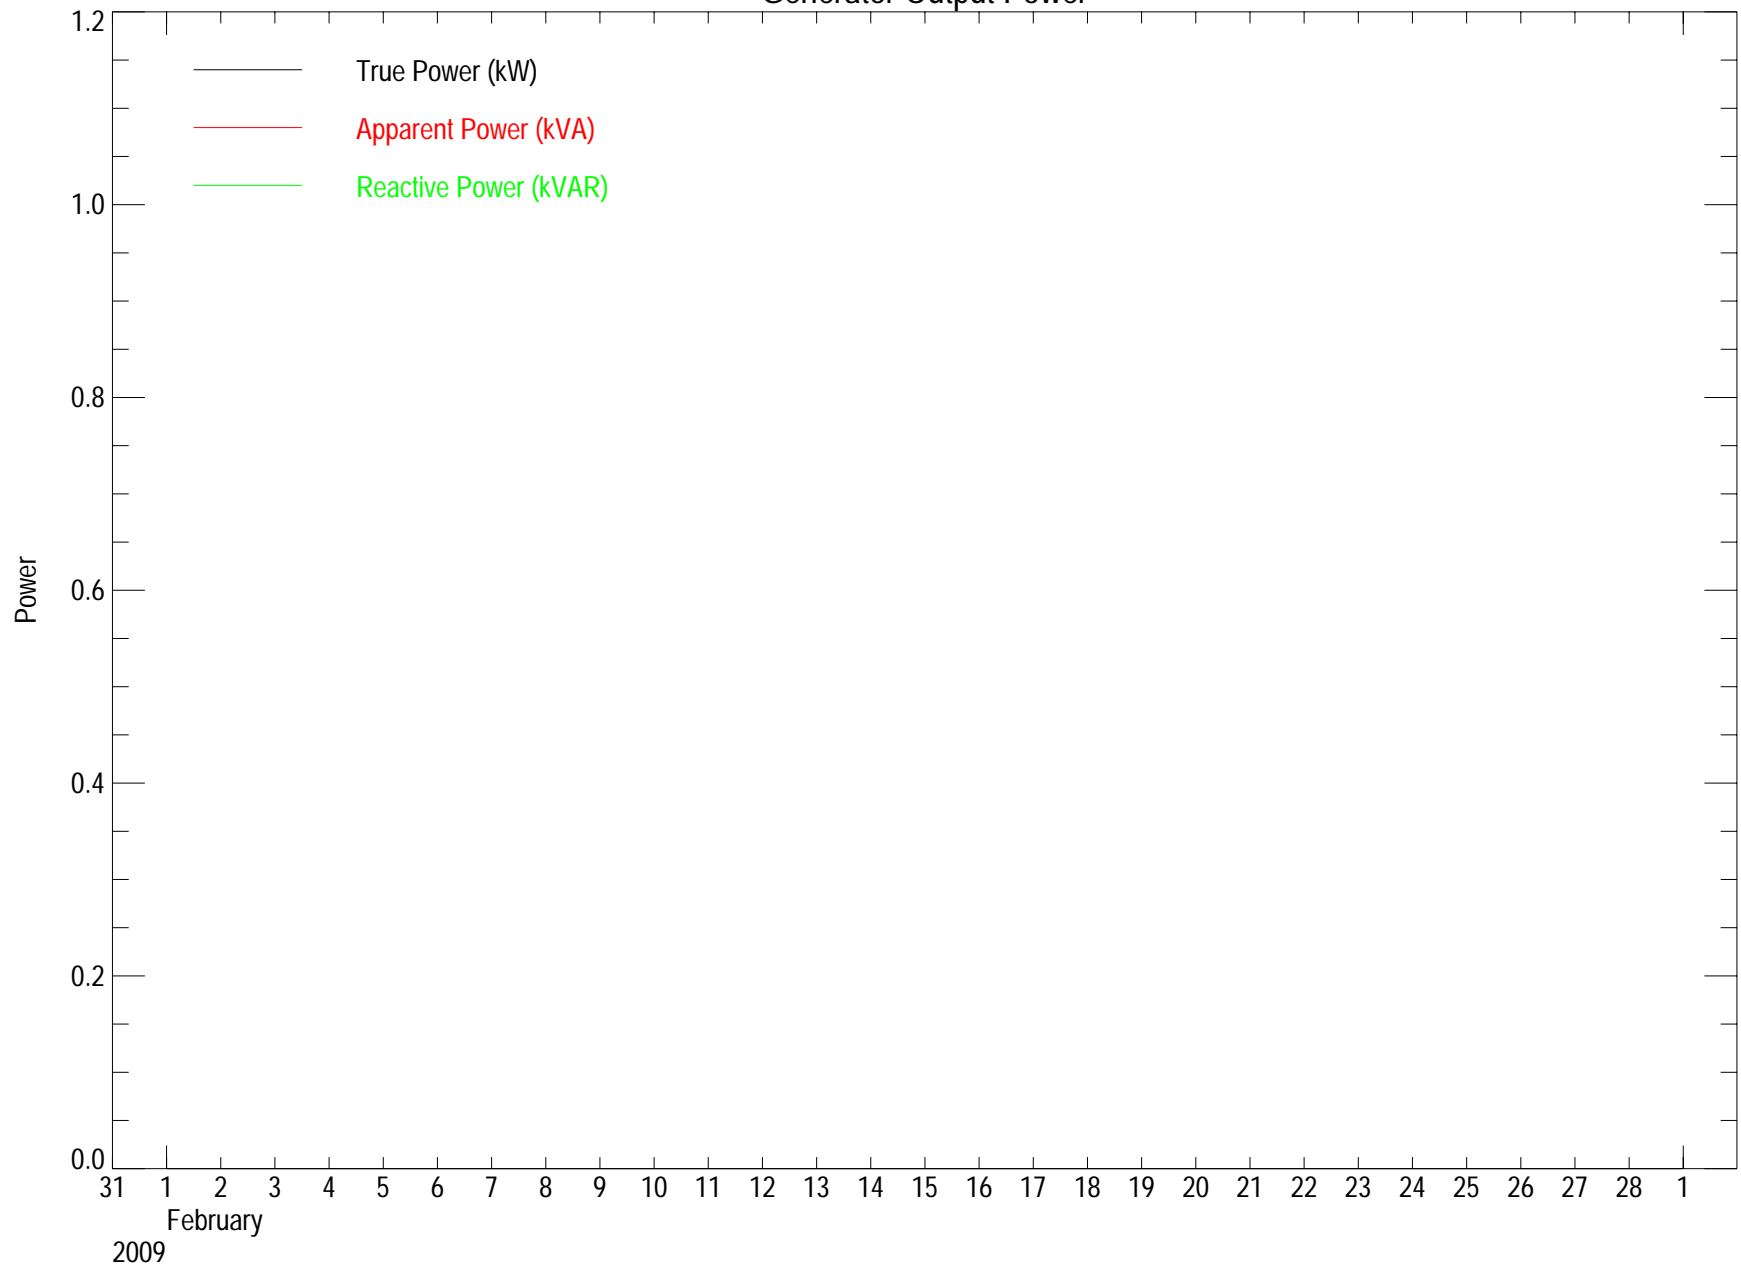

Generator Output Current

