

GENERATOR POWER QUALITY - DATA SUMMARY

Ten West 66th St. Corp.

03/01/09 to 03/31/09

	Line 1			Line 2			Line 3			Totals		
	Min	Avg	Max	Min	Avg	Max	Min	Avg	Max	Min	Avg	Max
Voltage (V)	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a
Current (amps)	0.50	21.34	94.88	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a
True Power (kW)	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	5.6	58.2	69.0
Apparent Power (kVA)	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a
Power Factor (-)	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a
Voltage THD (%)	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a
Current THD (%)	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a
Frequency (hz)	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a


GENERATOR POWER QUALITY - DATA SUMMARY

Ten West 66th St. Corp.

03/01/09 to 03/31/09

Date	Good Data (%)	Generator Apparent Power (kVAh)	Generator Reactive Power (kVARh)	Generator True Power (kWh)	Power Factor (-)
03/01/09	100.00	n/a	n/a	0.00	n/a
03/02/09	100.00	n/a	n/a	0.00	n/a
03/03/09	100.00	n/a	n/a	0.00	n/a
03/04/09	100.00	n/a	n/a	0.00	n/a
03/05/09	100.00	n/a	n/a	0.00	n/a
03/06/09	100.00	n/a	n/a	728.28	n/a
03/07/09	97.92	n/a	n/a	1362.84	n/a
03/08/09	4.17	n/a	n/a	57.23	n/a
03/09/09	42.71	n/a	n/a	398.11	n/a
03/10/09	0.00	n/a	n/a	-	n/a
03/11/09	0.00	n/a	n/a	-	n/a
03/12/09	0.00	n/a	n/a	-	n/a
03/13/09	0.00	n/a	n/a	-	n/a
03/14/09	0.00	n/a	n/a	-	n/a
03/15/09	0.00	n/a	n/a	-	n/a
03/16/09	0.00	n/a	n/a	-	n/a
03/17/09	0.00	n/a	n/a	-	n/a
03/18/09	0.00	n/a	n/a	-	n/a
03/19/09	0.00	n/a	n/a	-	n/a
03/20/09	0.00	n/a	n/a	-	n/a
03/21/09	0.00	n/a	n/a	-	n/a
03/22/09	0.00	n/a	n/a	-	n/a
03/23/09	0.00	n/a	n/a	-	n/a
03/24/09	0.00	n/a	n/a	-	n/a
03/25/09	0.00	n/a	n/a	-	n/a
03/26/09	0.00	n/a	n/a	-	n/a
03/27/09	0.00	n/a	n/a	-	n/a
03/28/09	0.00	n/a	n/a	-	n/a
03/29/09	0.00	n/a	n/a	-	n/a
03/30/09	0.00	n/a	n/a	-	n/a
03/31/09	0.00	n/a	n/a	-	n/a
Total	24.03	n/a	n/a	2546.46	n/a

Generator Output Power

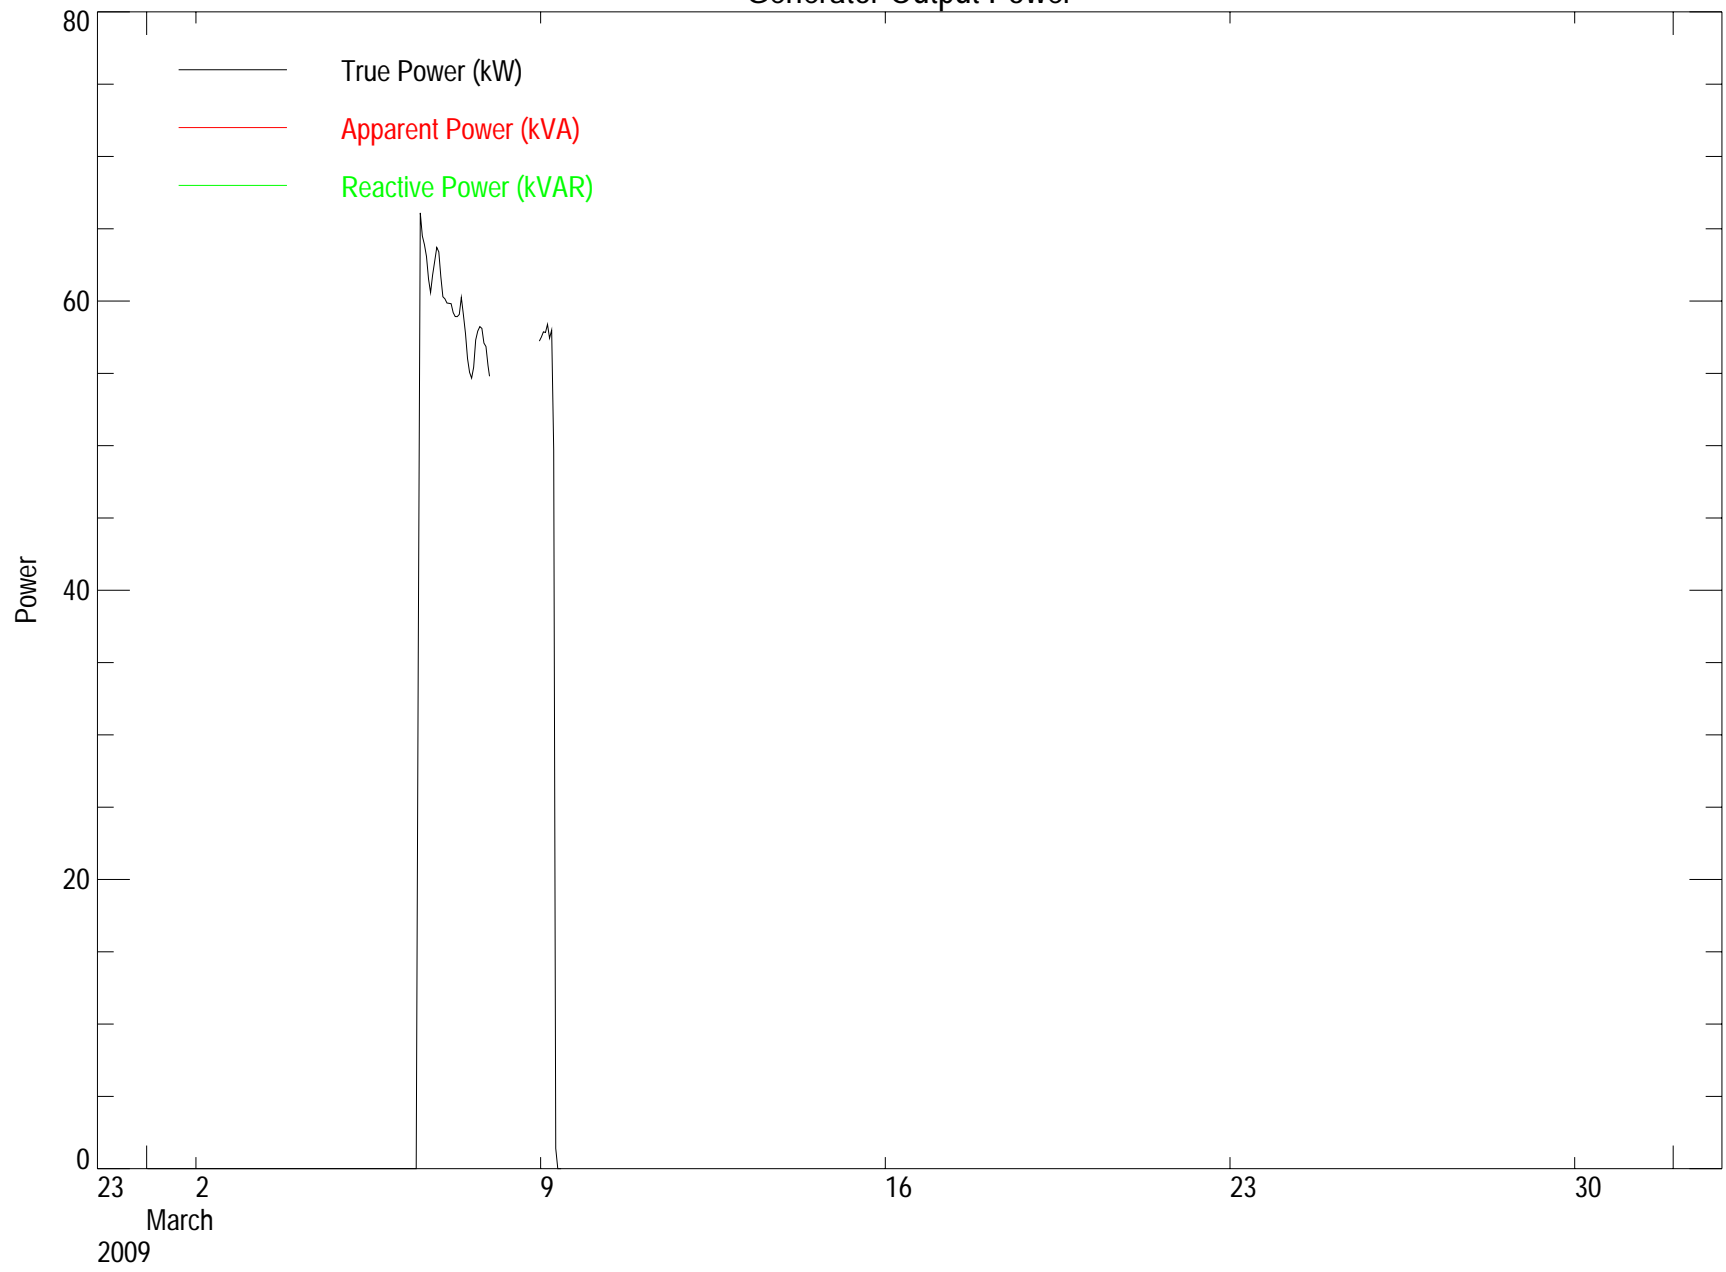

Generator Output Current

