

GENERATOR POWER QUALITY - DATA SUMMARY

Hazel Towers, Bronx, NY

11/01/08 to 11/30/08

	Line 1			Line 2			Line 3			Totals		
	Min	Avg	Max	Min	Avg	Max	Min	Avg	Max	Min	Avg	Max
Voltage (V)	260.4	287.4	298.3	257.7	286.6	297.1	259.6	288.1	298.5	n/a	n/a	n/a
Current (amps)	0.02	2.20	74.08	0.01	2.41	66.77	0.01	2.49	75.11	n/a	n/a	n/a
True Power (kW)	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	0.0	0.5	50.3
Apparent Power (kVA)	0.0	0.6	21.1	0.0	0.7	19.0	0.0	0.7	21.4	0.0	1.4	60.6
Power Factor (-)	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	0.01	0.58	1.00
Voltage THD (%)	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a
Current THD (%)	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a
Frequency (hz)	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	60.0	60.0	60.0


GENERATOR POWER QUALITY - DATA SUMMARY

Hazel Towers, Bronx, NY


11/01/08 to 11/30/08

Date	Good Data (%)	Generator Apparent Power (kVAh)	Generator Reactive Power (kVARh)	Generator True Power (kWh)	Power Factor (-)
11/01/08	100.00	106.67	82.73	0.00	-
11/02/08	100.00	106.55	85.77	0.00	-
11/03/08	100.00	148.92	121.30	36.86	0.25
11/04/08	100.00	106.10	83.38	0.00	-
11/05/08	100.00	111.33	89.24	0.00	-
11/06/08	100.00	108.49	87.44	0.00	-
11/07/08	100.00	47.95	35.81	0.44	0.01
11/08/08	100.00	10.45	1.89	0.67	0.06
11/09/08	100.00	9.37	0.90	0.90	0.10
11/10/08	100.00	10.55	1.91	0.64	0.06
11/11/08	100.00	9.99	2.17	0.43	0.04
11/12/08	100.00	9.58	1.77	0.81	0.08
11/13/08	100.00	10.06	1.34	0.70	0.07
11/14/08	100.00	8.29	0.99	0.65	0.08
11/15/08	100.00	8.78	1.13	0.76	0.09
11/16/08	100.00	8.97	2.06	0.45	0.05
11/17/08	100.00	9.13	1.59	0.77	0.08
11/18/08	100.00	9.06	1.43	0.78	0.09
11/19/08	100.00	9.88	1.34	0.71	0.07
11/20/08	100.00	10.02	1.28	0.79	0.08
11/21/08	100.00	10.11	1.00	0.88	0.09
11/22/08	100.00	8.70	1.09	0.47	0.05
11/23/08	100.00	10.18	2.31	0.39	0.04
11/24/08	100.00	8.99	2.13	0.81	0.09
11/25/08	100.00	8.95	3.32	0.93	0.10
11/26/08	100.00	10.46	6.03	0.89	0.08
11/27/08	100.00	9.97	8.34	1.15	0.12
11/28/08	100.00	21.55	18.31	7.26	0.34
11/29/08	100.00	9.08	1.69	0.52	0.06
11/30/08	100.00	10.29	2.53	0.58	0.06
Total	100.00	968.41	652.18	60.21	0.06


Generator Output Power

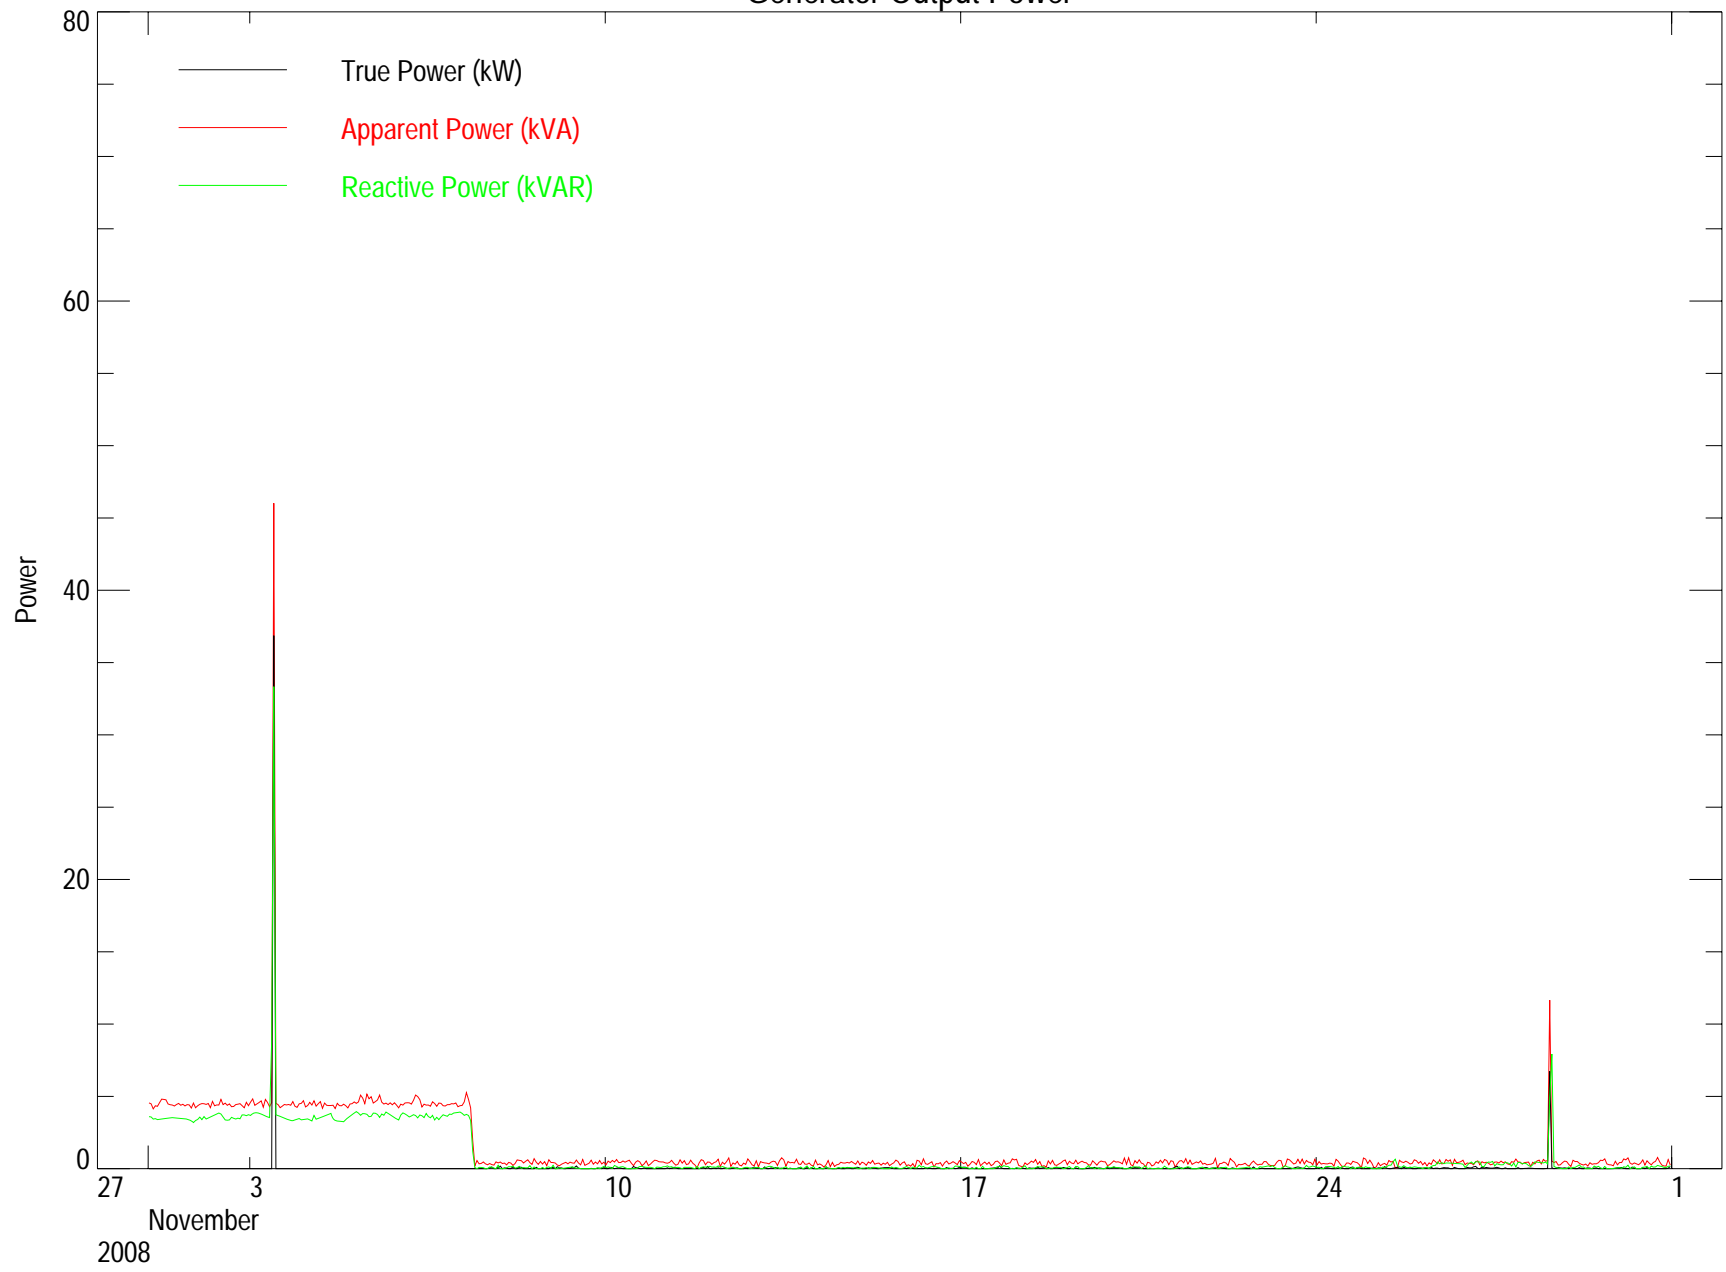

Generator Output Voltage

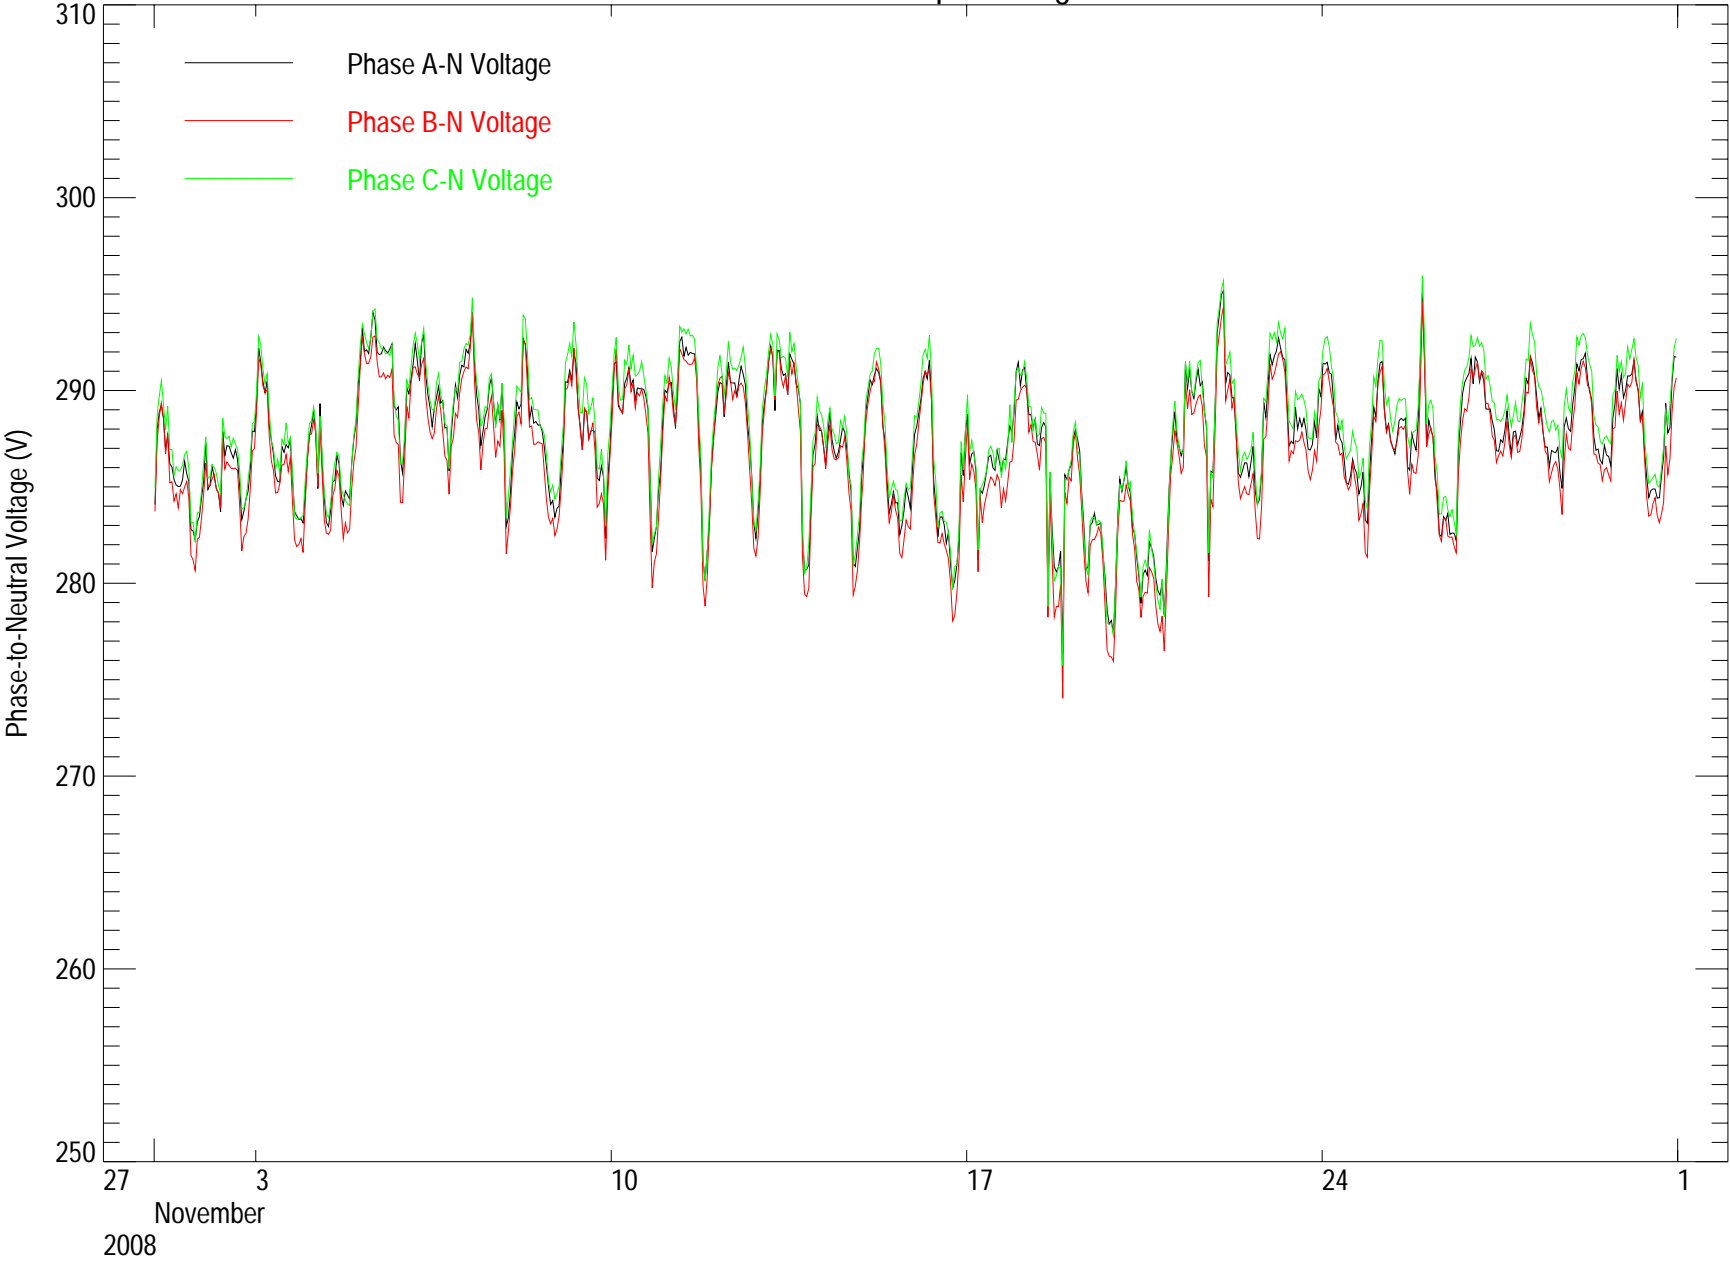

Generator Output Current

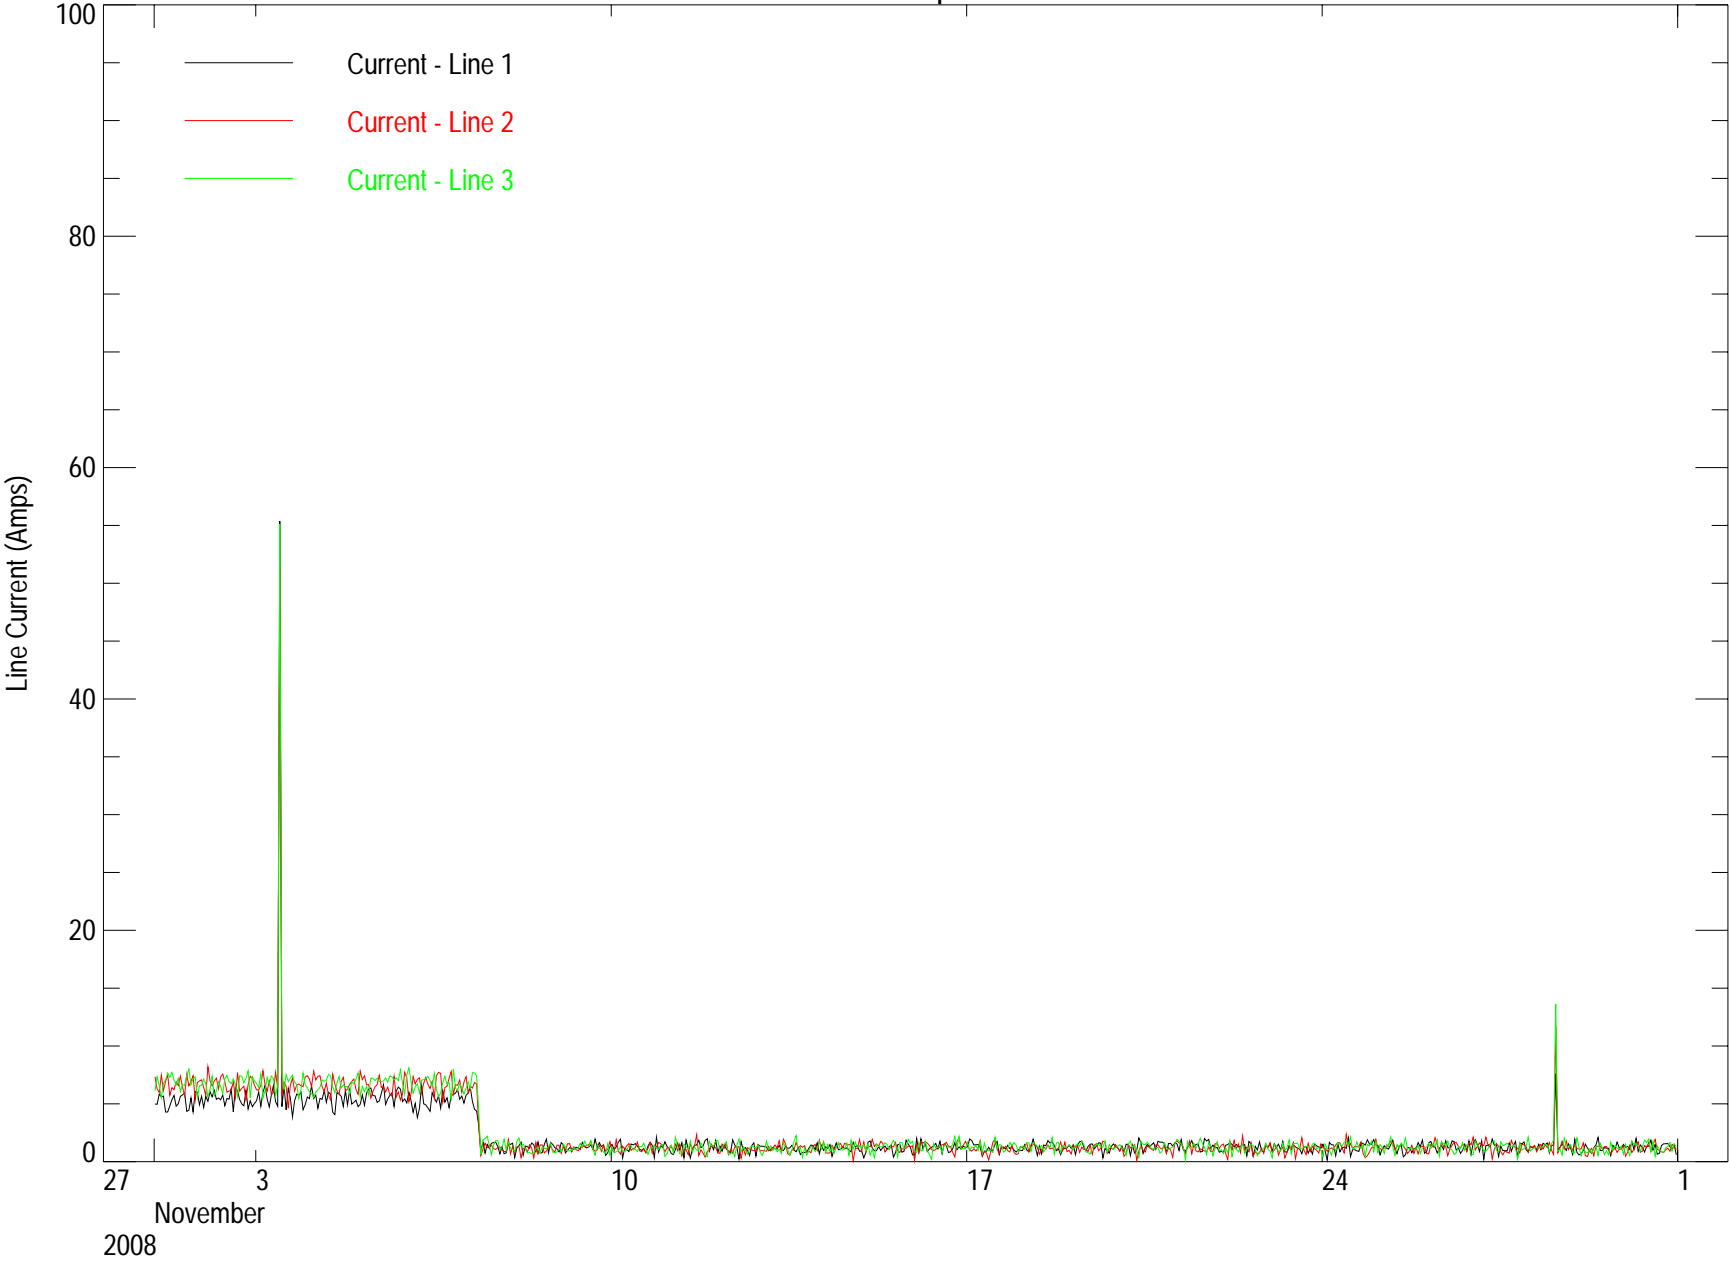

Generator Output Power Factor

