

GENERATOR POWER QUALITY - DATA SUMMARY

Hazel Towers, Bronx, NY

01/01/08 to 12/31/08

	Line 1			Line 2			Line 3			Totals		
	Min	Avg	Max	Min	Avg	Max	Min	Avg	Max	Min	Avg	Max
Voltage (V)	260.4	285.9	298.3	257.7	284.3	297.1	259.6	285.6	298.5	n/a	n/a	n/a
Current (amps)	0.01	51.54	235.48	0.01	49.79	226.00	0.01	53.31	236.52	n/a	n/a	n/a
True Power (kW)	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	0.0	50.3	114.8
Apparent Power (kVA)	0.0	14.7	67.2	0.0	14.1	60.6	0.0	15.2	62.7	0.0	44.0	147.5
Power Factor (-)	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	0.01	0.75	1.00
Voltage THD (%)	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a
Current THD (%)	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a
Frequency (hz)	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	60.0	60.0	60.1


GENERATOR POWER QUALITY - DATA SUMMARY

Hazel Towers, Bronx, NY

01/01/08 to 12/31/08

Date	Good Data (%)	Generator Apparent Power (kVAh)	Generator Reactive Power (kVARh)	Generator True Power (kWh)	Power Factor (-)
Jan 2008	100.00	66028.87	37405.88	54621.20	0.83
Feb 2008	93.10	24812.70	15513.15	18590.90	0.75
Mar 2008	100.00	27625.70	16630.71	21903.34	0.79
Apr 2008	100.00	41767.84	26327.03	32692.53	0.78
May 2008	100.00	35962.95	22787.45	27561.99	0.77
Jun 2008	100.00	40961.41	25912.94	31954.72	0.78
Jul 2008	100.00	43390.98	27203.63	34053.89	0.78
Aug 2008	100.00	29087.66	18341.45	22121.23	0.76
Sep 2008	100.00	25970.66	15153.57	19859.79	0.76
Oct 2008	100.00	35789.24	21854.31	27802.45	0.78
Nov 2008	100.00	968.41	652.18	60.21	0.06
Dec 2008	100.00	10648.15	7721.21	7361.91	0.69
Total	99.45	383014.56	235503.50	298584.16	0.78


Generator Output Power

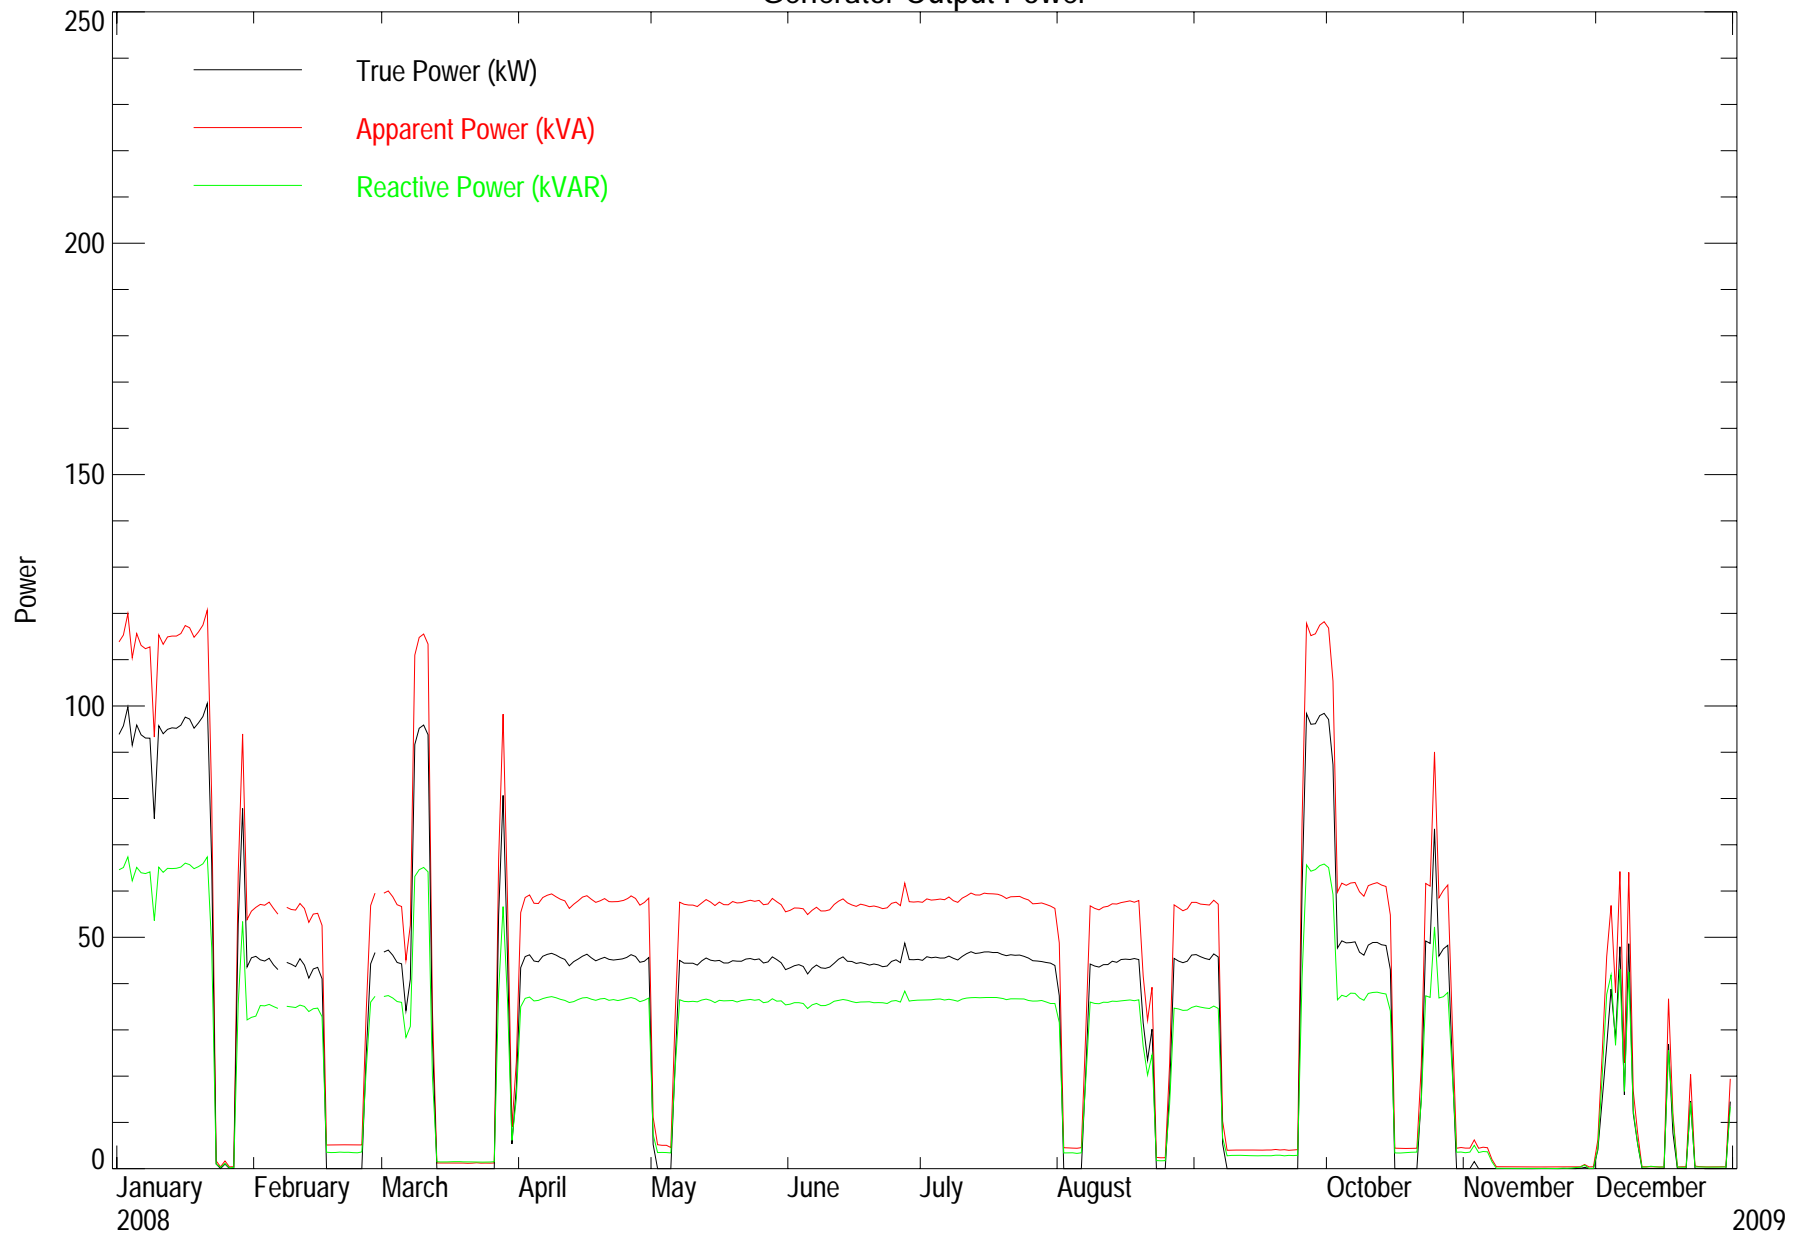

Generator Output Voltage



Generator Output Current

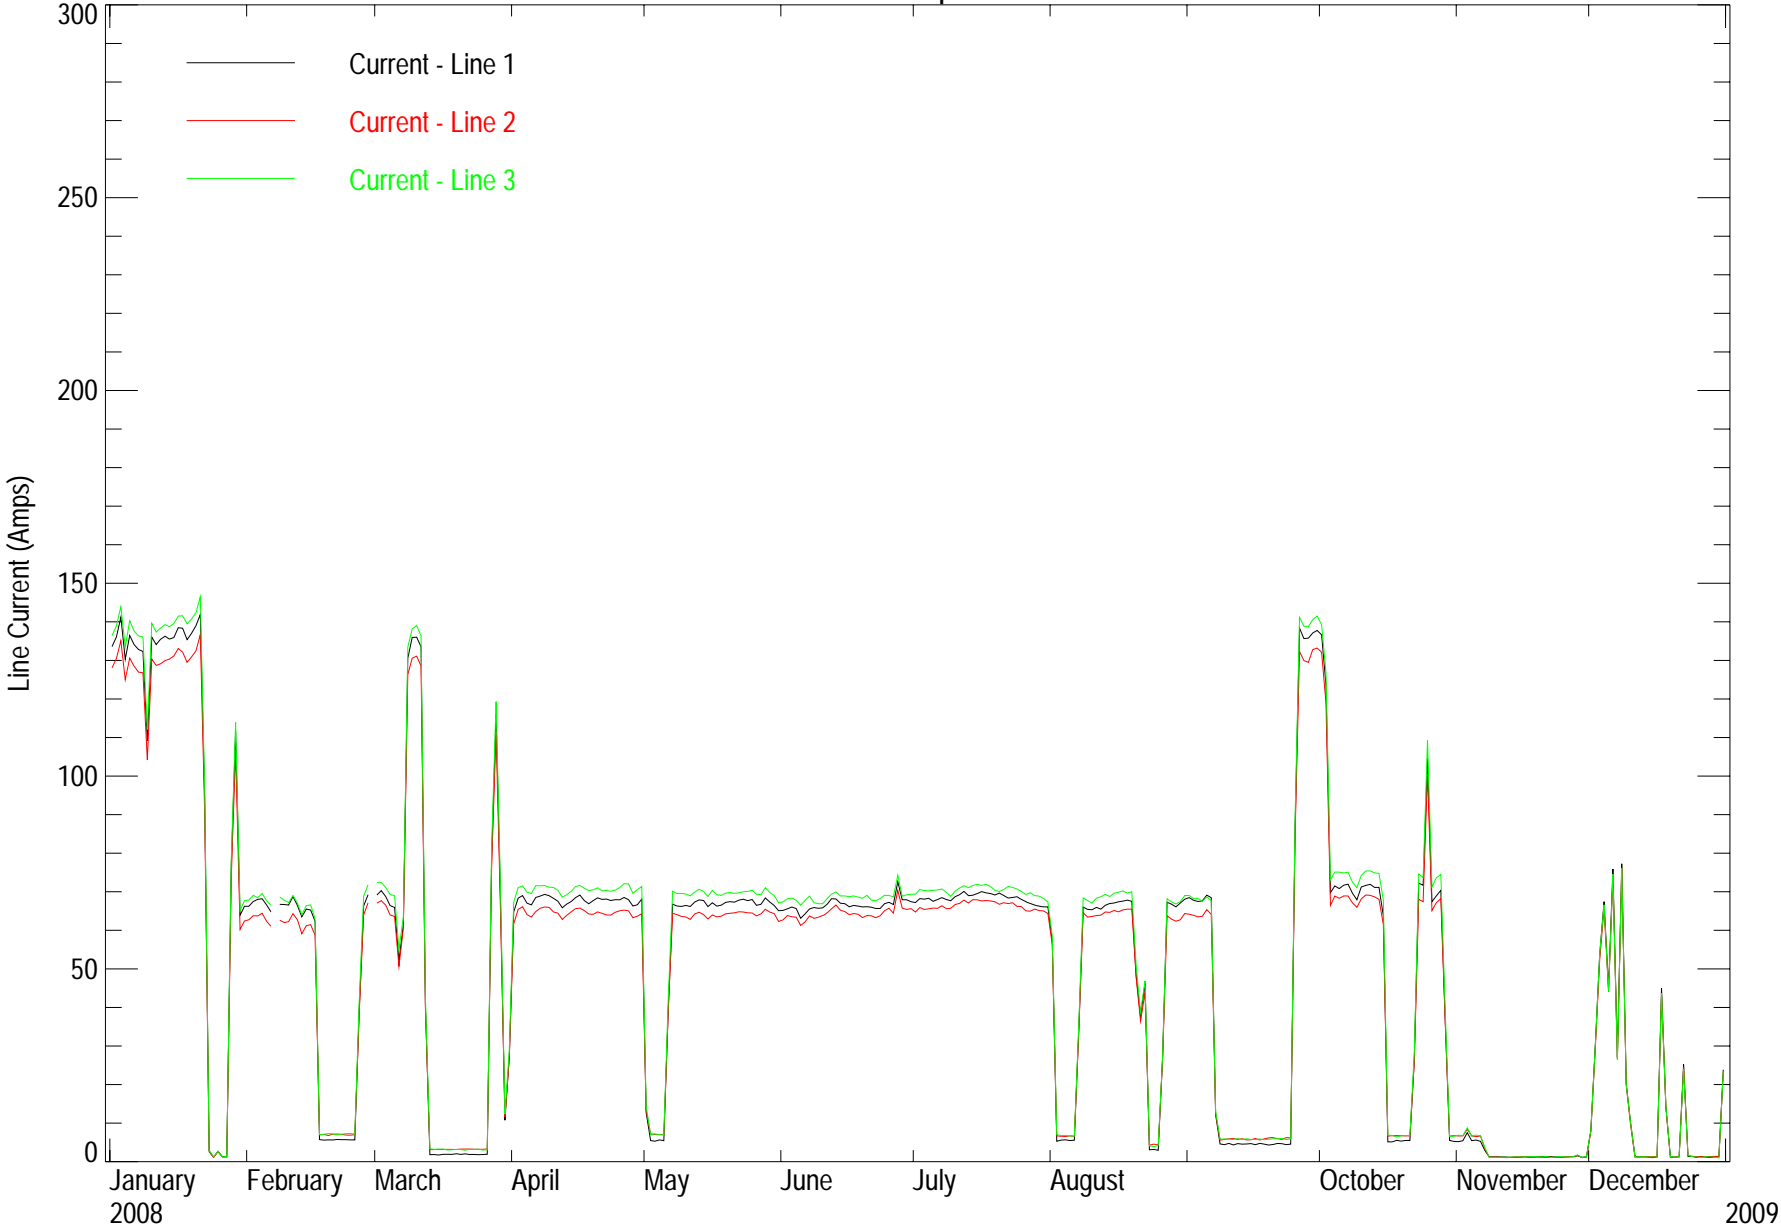

Generator Output Power Factor

