

GENERATOR POWER QUALITY - DATA SUMMARY

Hazel Towers, Bronx, NY

01/01/09 to 05/31/09

	Line 1			Line 2			Line 3			Totals		
	Min	Avg	Max	Min	Avg	Max	Min	Avg	Max	Min	Avg	Max
Voltage (V)	276.5	284.4	296.0	274.6	283.2	294.8	275.7	284.5	296.9	n/a	n/a	n/a
Current (amps)	0.02	111.66	180.95	0.01	113.62	177.27	0.01	114.38	177.35	n/a	n/a	n/a
True Power (kW)	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	0.0	92.8	116.0
Apparent Power (kVA)	0.0	31.6	51.0	0.0	32.0	50.0	0.0	32.3	50.2	0.0	94.6	150.7
Power Factor (-)	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	0.01	0.70	0.99
Voltage THD (%)	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a
Current THD (%)	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a
Frequency (hz)	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	60.0	60.0	60.0


GENERATOR POWER QUALITY - DATA SUMMARY

Hazel Towers, Bronx, NY

01/01/09 to 05/31/09

Date	Good Data (%)	Generator Apparent Power (kVAh)	Generator Reactive Power (kVARh)	Generator True Power (kWh)	Power Factor (-)
Jan 2009	100.00	34116.99	23239.29	25541.99	0.75
Feb 2009	100.00	91136.64	60943.68	69659.52	0.76
Mar 2009	96.77	25598.27	17117.95	19566.03	0.76
Apr 2009	100.00	-	-	0.00	-
May 2009	12.77	-	-	0.00	-
Total	81.43	150851.89	101300.92	114767.54	0.76


Generator Output Power

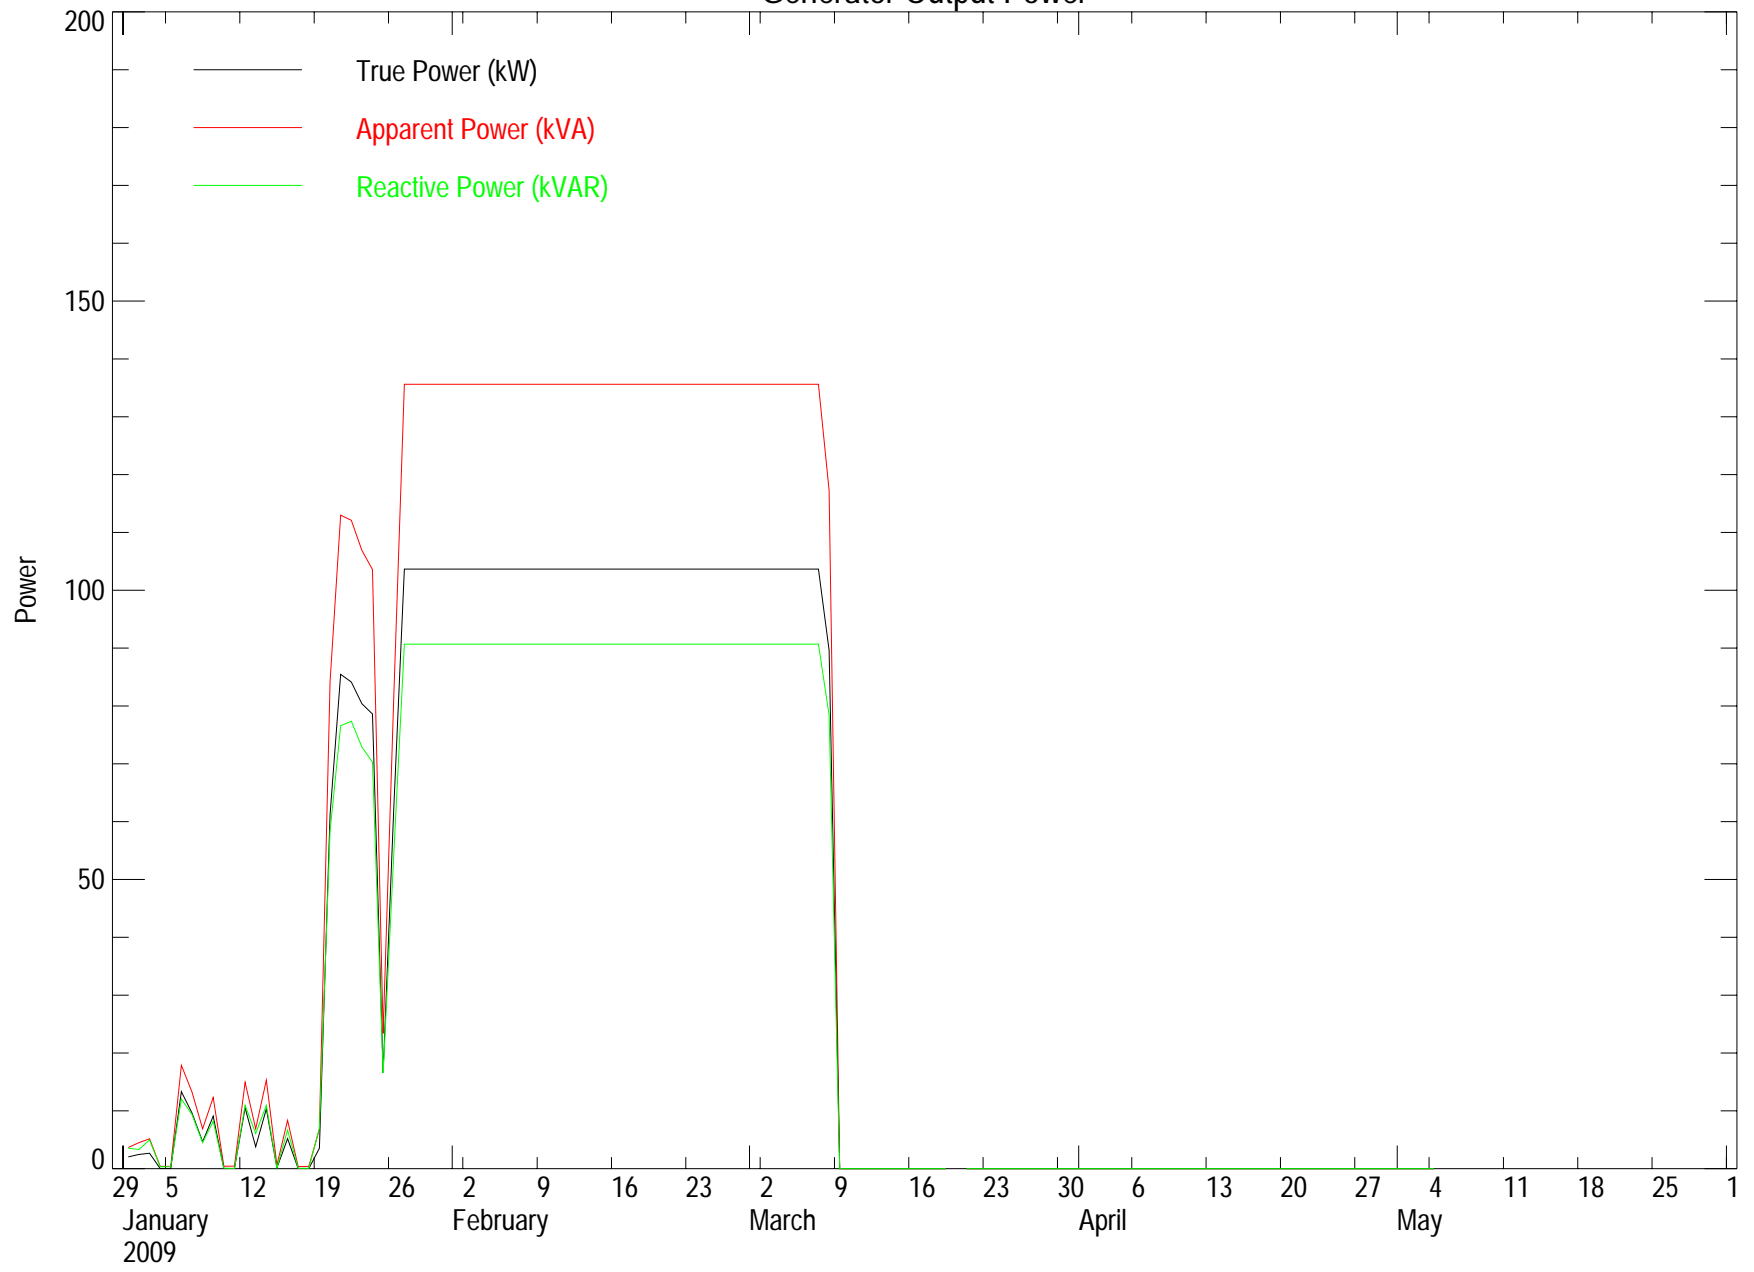

Generator Output Voltage



Generator Output Current

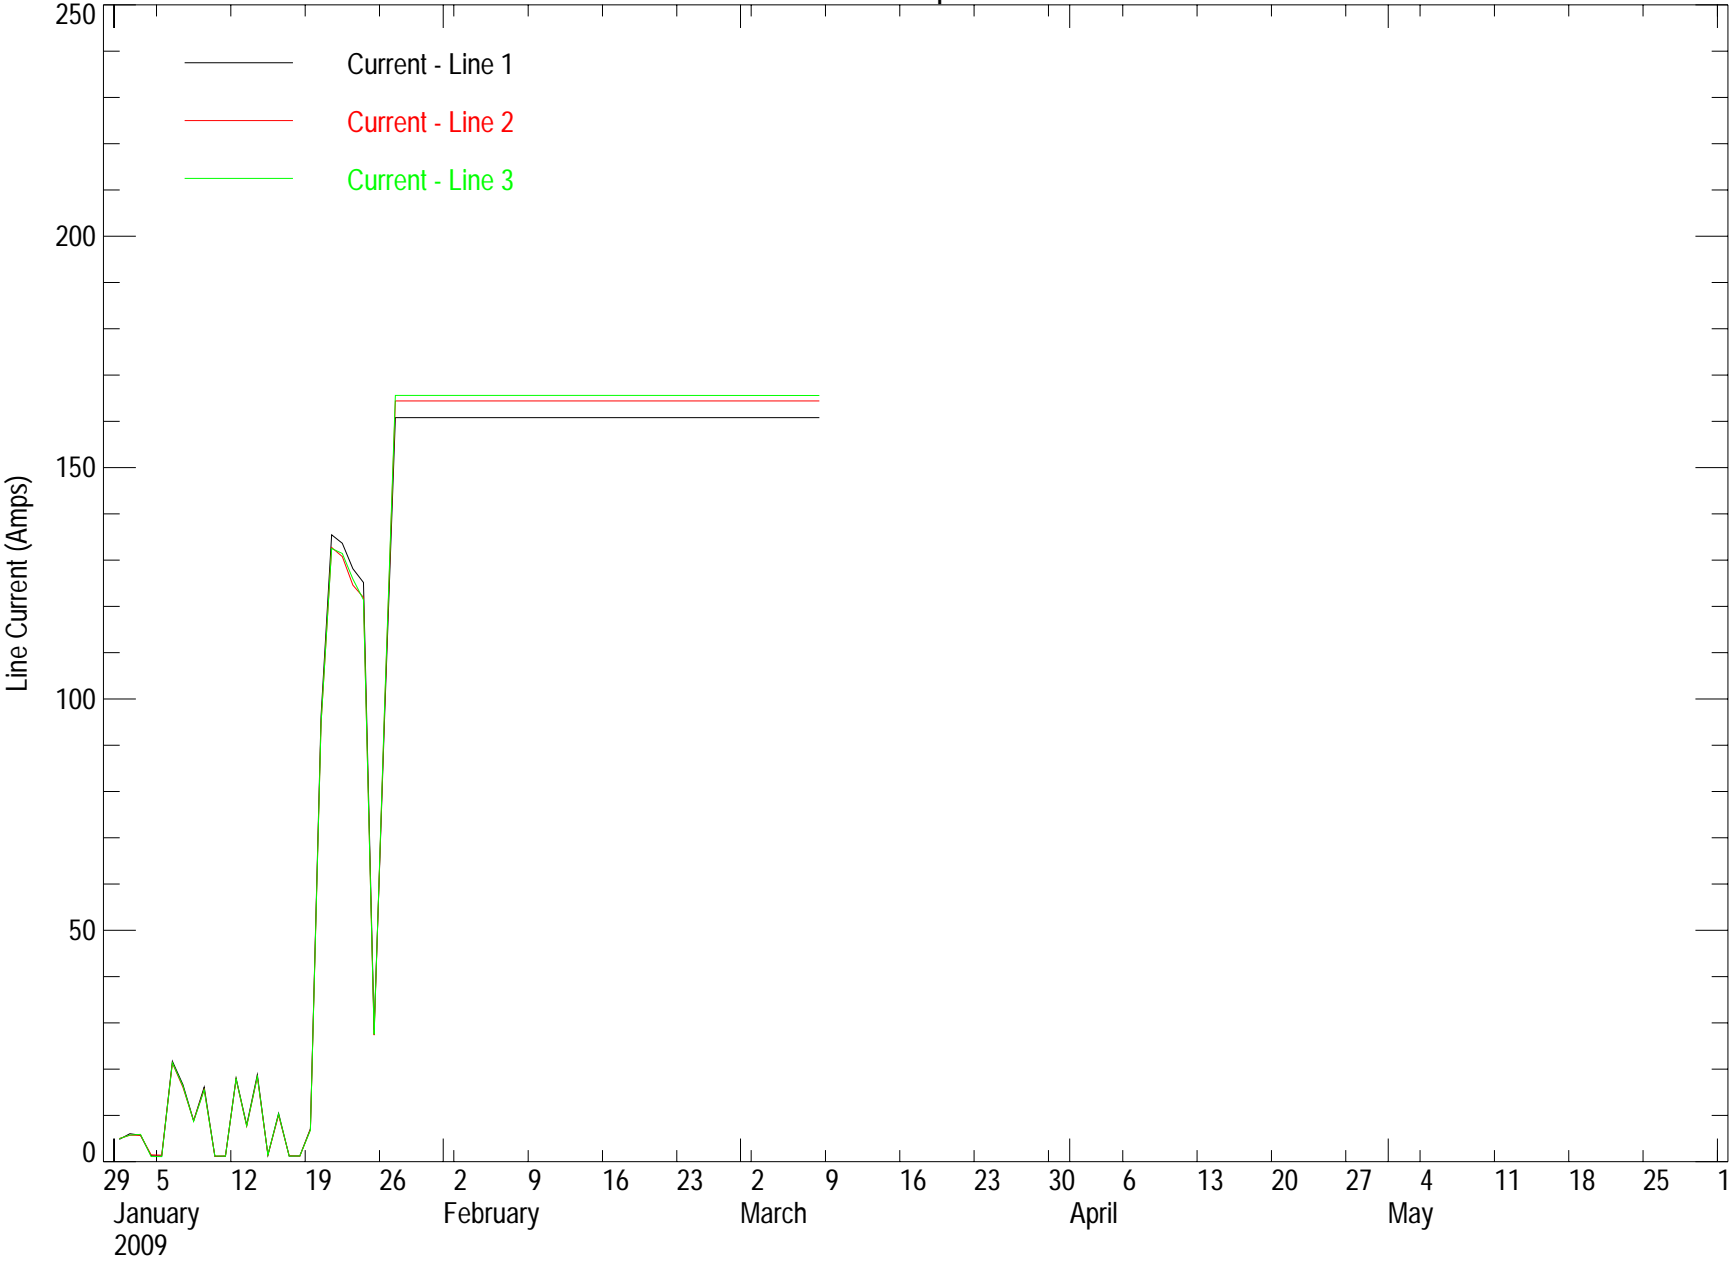

Generator Output Power Factor

