

## FACILITY POWER QUALITY - DATA SUMMARY

Arrow Linen

04/01/05 to 04/30/05

### Generator Off

	Line 1			Line 2			Line 3			Totals		
	Min	Avg	Max	Min	Avg	Max	Min	Avg	Max	Min	Avg	Max
Voltage (V)	121.7	125.7	127.7	121.9	125.2	127.2	121.9	125.2	127.9	n/a	n/a	n/a
Current (amps)	-	-	-	-	-	-	-	-	-	n/a	n/a	n/a
True Power (kW)	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	7.2	30.8	159.2
Apparent Power (kVA)	-	-	-	-	-	-	-	-	-	-	-	-
Power Factor (-)	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	-	-	-
Voltage THD (%)	-	-	-	-	-	-	-	-	-	n/a	n/a	n/a
Current THD (%)	-	-	-	-	-	-	-	-	-	n/a	n/a	n/a
Frequency (hz)	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	-	-	-

### Generator On

	Line 1			Line 2			Line 3			Totals		
	Min	Avg	Max	Min	Avg	Max	Min	Avg	Max	Min	Avg	Max
Voltage (V)	118.1	122.2	127.5	117.8	122.0	126.8	118.0	122.0	126.5	n/a	n/a	n/a
Current (amps)	-	-	-	-	-	-	-	-	-	n/a	n/a	n/a
True Power (kW)	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	0.2	54.4	234.6
Apparent Power (kVA)	-	-	-	-	-	-	-	-	-	-	-	-
Power Factor (-)	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	-	-	-
Voltage THD (%)	-	-	-	-	-	-	-	-	-	n/a	n/a	n/a
Current THD (%)	-	-	-	-	-	-	-	-	-	n/a	n/a	n/a
Frequency (hz)	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	-	-	-


## FACILITY POWER QUALITY - DATA SUMMARY

Arrow Linen

04/01/05 to 04/30/05

Date	Good Data (%)	Facility Apparent Power (kVAh)	Facility Reactive Power (kVARh)	Facility True Power (kWh)	Power Factor (-)
04/01/05	100.00	-	-	1246.70	-
04/02/05	3.13	-	-	12.40	-
04/03/05	100.00	-	-	925.30	-
04/04/05	100.00	-	-	1350.10	-
04/05/05	100.00	-	-	1036.30	-
04/06/05	100.00	-	-	903.40	-
04/07/05	100.00	-	-	1166.00	-
04/08/05	100.00	-	-	1241.10	-
04/09/05	67.71	-	-	669.20	-
04/10/05	100.00	-	-	269.10	-
04/11/05	100.00	-	-	987.70	-
04/12/05	100.00	-	-	994.20	-
04/13/05	100.00	-	-	928.10	-
04/14/05	100.00	-	-	1085.10	-
04/15/05	100.00	-	-	984.40	-
04/16/05	100.00	-	-	918.30	-
04/17/05	100.00	-	-	892.10	-
04/18/05	100.00	-	-	1298.40	-
04/19/05	100.00	-	-	1056.20	-
04/20/05	100.00	-	-	1070.00	-
04/21/05	100.00	-	-	1231.70	-
04/22/05	100.00	-	-	1032.00	-
04/23/05	100.00	-	-	897.70	-
04/24/05	100.00	-	-	777.30	-
04/25/05	100.00	-	-	1075.80	-
04/26/05	100.00	-	-	1081.60	-
04/27/05	100.00	-	-	1045.40	-
04/28/05	100.00	-	-	966.40	-
04/29/05	100.00	-	-	1081.30	-
04/30/05	95.83	-	-	912.10	-
Total	95.56	-	-	29135.40	-

# Facility Purchased Power

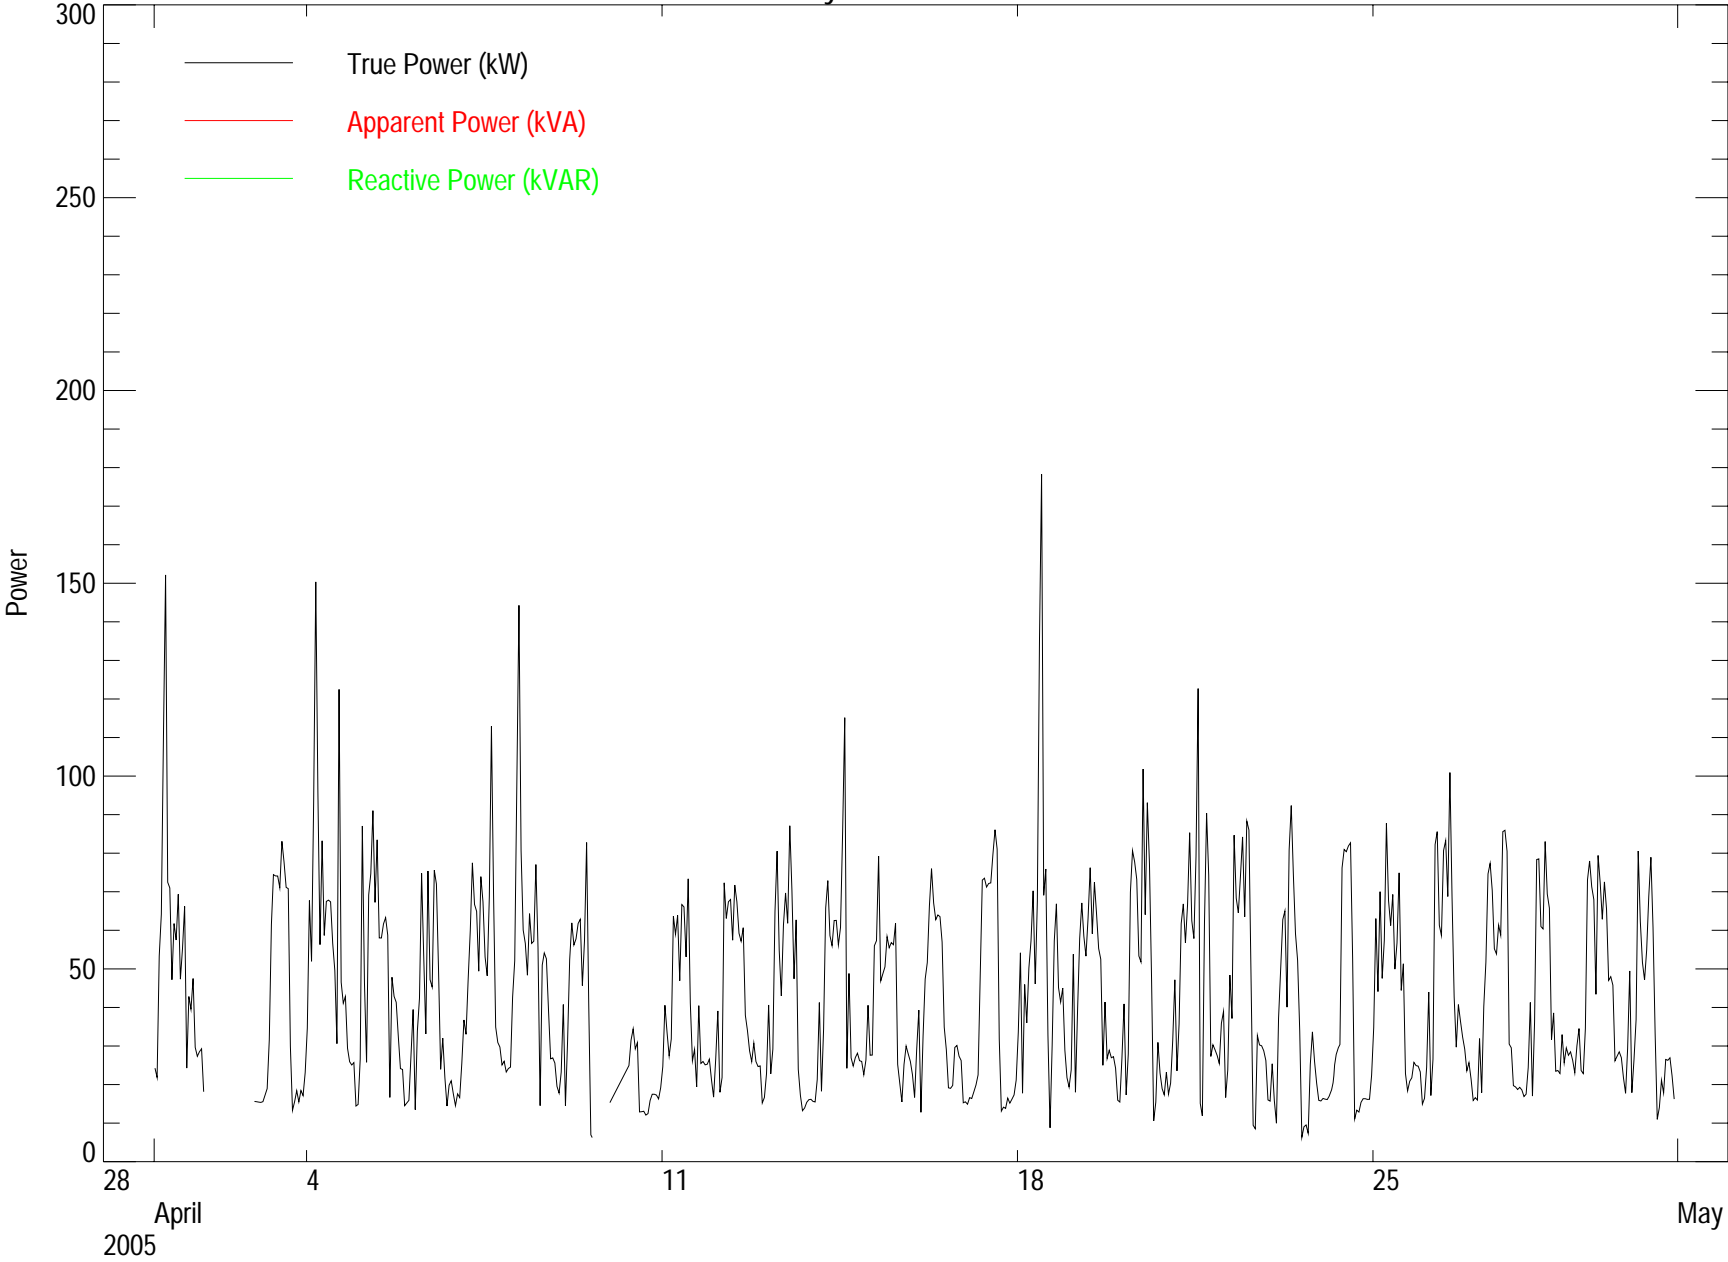

# Facility Voltage

