

FACILITY POWER QUALITY - DATA SUMMARY

Arrow Linen

06/01/05 to 06/30/05

Generator Off

	Line 1			Line 2			Line 3			Totals		
	Min	Avg	Max	Min	Avg	Max	Min	Avg	Max	Min	Avg	Max
Voltage (V)	118.2	125.6	130.5	117.8	124.9	127.4	116.7	125.1	131.3	n/a	n/a	n/a
Current (amps)	-	-	-	-	-	-	-	-	-	n/a	n/a	n/a
True Power (kW)	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	11.1	30.7	167.0
Apparent Power (kVA)	-	-	-	-	-	-	-	-	-	-	-	-
Power Factor (-)	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	-	-	-
Voltage THD (%)	-	-	-	-	-	-	-	-	-	n/a	n/a	n/a
Current THD (%)	-	-	-	-	-	-	-	-	-	n/a	n/a	n/a
Frequency (hz)	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	-	-	-

Generator On

	Line 1			Line 2			Line 3			Totals		
	Min	Avg	Max	Min	Avg	Max	Min	Avg	Max	Min	Avg	Max
Voltage (V)	110.9	121.5	128.1	108.8	121.2	126.3	108.9	121.4	127.1	n/a	n/a	n/a
Current (amps)	-	-	-	-	-	-	-	-	-	n/a	n/a	n/a
True Power (kW)	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	-1.0	67.5	286.6
Apparent Power (kVA)	-	-	-	-	-	-	-	-	-	-	-	-
Power Factor (-)	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	-	-	-
Voltage THD (%)	-	-	-	-	-	-	-	-	-	n/a	n/a	n/a
Current THD (%)	-	-	-	-	-	-	-	-	-	n/a	n/a	n/a
Frequency (hz)	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	-	-	-


FACILITY POWER QUALITY - DATA SUMMARY

Arrow Linen

06/01/05 to 06/30/05

Date	Good Data (%)	Facility Apparent Power (kVAh)	Facility Reactive Power (kVARh)	Facility True Power (kWh)	Power Factor (-)
06/01/05	100.00	-	-	1239.30	-
06/02/05	100.00	-	-	1092.90	-
06/03/05	100.00	-	-	1215.00	-
06/04/05	100.00	-	-	1069.20	-
06/05/05	100.00	-	-	498.80	-
06/06/05	100.00	-	-	1446.50	-
06/07/05	100.00	-	-	1318.60	-
06/08/05	100.00	-	-	1388.50	-
06/09/05	100.00	-	-	1463.20	-
06/10/05	100.00	-	-	1377.90	-
06/11/05	100.00	-	-	1131.80	-
06/12/05	100.00	-	-	581.50	-
06/13/05	100.00	-	-	1386.50	-
06/14/05	100.00	-	-	1421.20	-
06/15/05	100.00	-	-	2142.80	-
06/16/05	100.00	-	-	1112.50	-
06/17/05	100.00	-	-	1261.80	-
06/18/05	100.00	-	-	1117.10	-
06/19/05	100.00	-	-	511.60	-
06/20/05	100.00	-	-	1290.90	-
06/21/05	100.00	-	-	1275.00	-
06/22/05	100.00	-	-	1331.30	-
06/23/05	100.00	-	-	1188.80	-
06/24/05	100.00	-	-	1323.90	-
06/25/05	100.00	-	-	1292.60	-
06/26/05	100.00	-	-	507.90	-
06/27/05	100.00	-	-	1361.40	-
06/28/05	100.00	-	-	1307.10	-
06/29/05	100.00	-	-	1246.00	-
06/30/05	95.83	-	-	1239.80	-
Total	99.86	-	-	36141.40	-

Facility Purchased Power

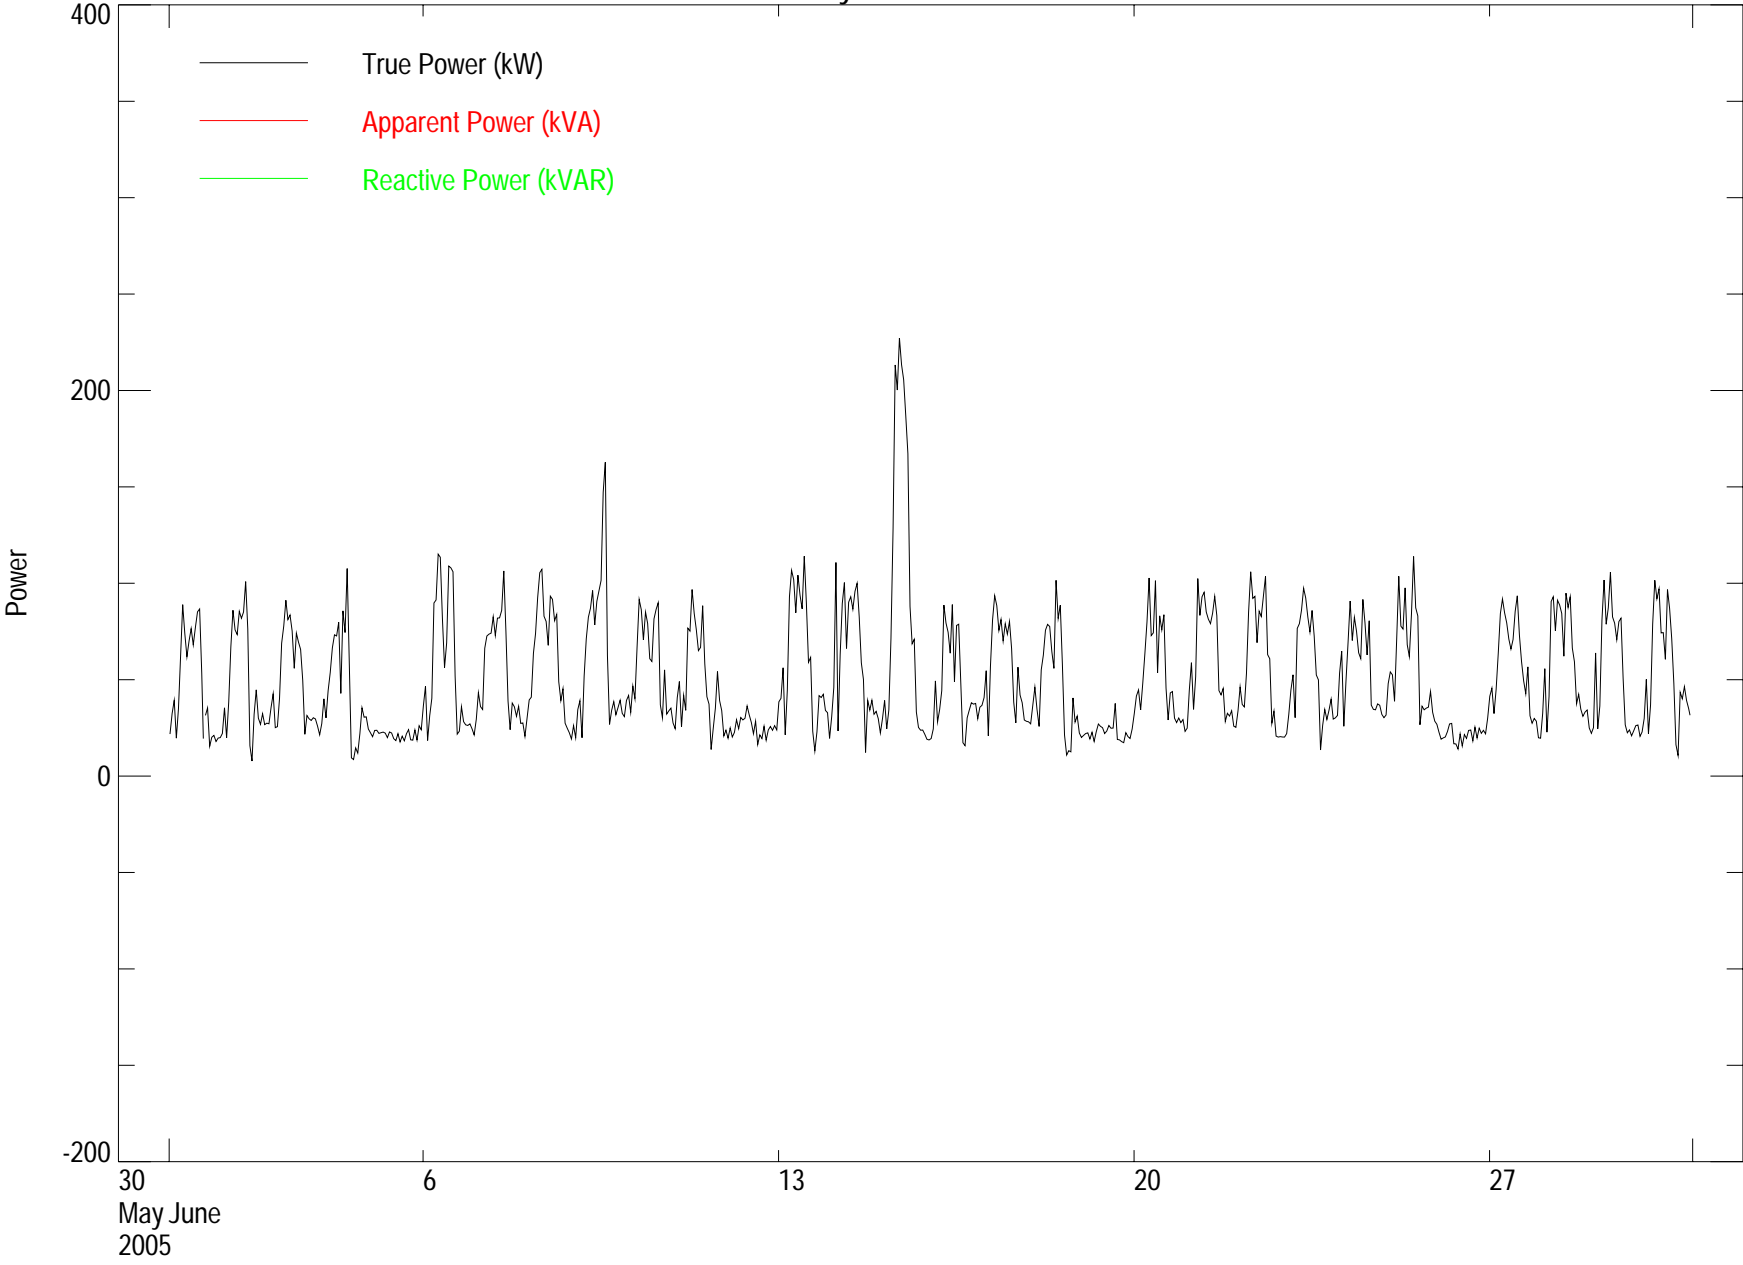

Facility Voltage

