

FACILITY POWER QUALITY - DATA SUMMARY

Arrow Linen

07/01/05 to 07/31/05

Generator Off

	Line 1			Line 2			Line 3			Totals		
	Min	Avg	Max	Min	Avg	Max	Min	Avg	Max	Min	Avg	Max
Voltage (V)	118.4	125.7	129.3	98.8	124.9	127.7	119.0	125.1	128.8	n/a	n/a	n/a
Current (amps)	-	-	-	-	-	-	-	-	-	n/a	n/a	n/a
True Power (kW)	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	10.6	34.1	177.1
Apparent Power (kVA)	-	-	-	-	-	-	-	-	-	-	-	-
Power Factor (-)	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	-	-	-
Voltage THD (%)	-	-	-	-	-	-	-	-	-	n/a	n/a	n/a
Current THD (%)	-	-	-	-	-	-	-	-	-	n/a	n/a	n/a
Frequency (hz)	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	-	-	-

Generator On

	Line 1			Line 2			Line 3			Totals		
	Min	Avg	Max	Min	Avg	Max	Min	Avg	Max	Min	Avg	Max
Voltage (V)	117.9	121.7	127.5	117.8	121.4	126.1	118.1	121.5	126.7	n/a	n/a	n/a
Current (amps)	-	-	-	-	-	-	-	-	-	n/a	n/a	n/a
True Power (kW)	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	0.0	63.2	170.3
Apparent Power (kVA)	-	-	-	-	-	-	-	-	-	-	-	-
Power Factor (-)	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	-	-	-
Voltage THD (%)	-	-	-	-	-	-	-	-	-	n/a	n/a	n/a
Current THD (%)	-	-	-	-	-	-	-	-	-	n/a	n/a	n/a
Frequency (hz)	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	-	-	-


FACILITY POWER QUALITY - DATA SUMMARY

Arrow Linen

07/01/05 to 07/31/05

Date	Good Data (%)	Facility Apparent Power (kVAh)	Facility Reactive Power (kVARh)	Facility True Power (kWh)	Power Factor (-)
07/01/05	98.96	-	-	1322.20	-
07/02/05	100.00	-	-	1154.40	-
07/03/05	100.00	-	-	469.10	-
07/04/05	100.00	-	-	1242.60	-
07/05/05	100.00	-	-	1180.00	-
07/06/05	100.00	-	-	1166.90	-
07/07/05	100.00	-	-	1116.50	-
07/08/05	100.00	-	-	1132.30	-
07/09/05	100.00	-	-	1145.10	-
07/10/05	100.00	-	-	470.30	-
07/11/05	100.00	-	-	1313.80	-
07/12/05	100.00	-	-	1255.70	-
07/13/05	100.00	-	-	1159.50	-
07/14/05	100.00	-	-	1202.00	-
07/15/05	100.00	-	-	1277.50	-
07/16/05	100.00	-	-	962.50	-
07/17/05	100.00	-	-	1.40	-
07/18/05	100.00	-	-	401.40	-
07/19/05	100.00	-	-	1373.40	-
07/20/05	95.83	-	-	1212.00	-
07/21/05	100.00	-	-	1297.50	-
07/22/05	100.00	-	-	1415.20	-
07/23/05	100.00	-	-	1092.60	-
07/24/05	100.00	-	-	658.50	-
07/25/05	100.00	-	-	1340.70	-
07/26/05	100.00	-	-	1339.70	-
07/27/05	100.00	-	-	1340.80	-
07/28/05	100.00	-	-	1174.50	-
07/29/05	100.00	-	-	1290.00	-
07/30/05	100.00	-	-	1147.20	-
07/31/05	95.83	-	-	449.90	-
Total	99.70	-	-	33105.20	-

Facility Purchased Power

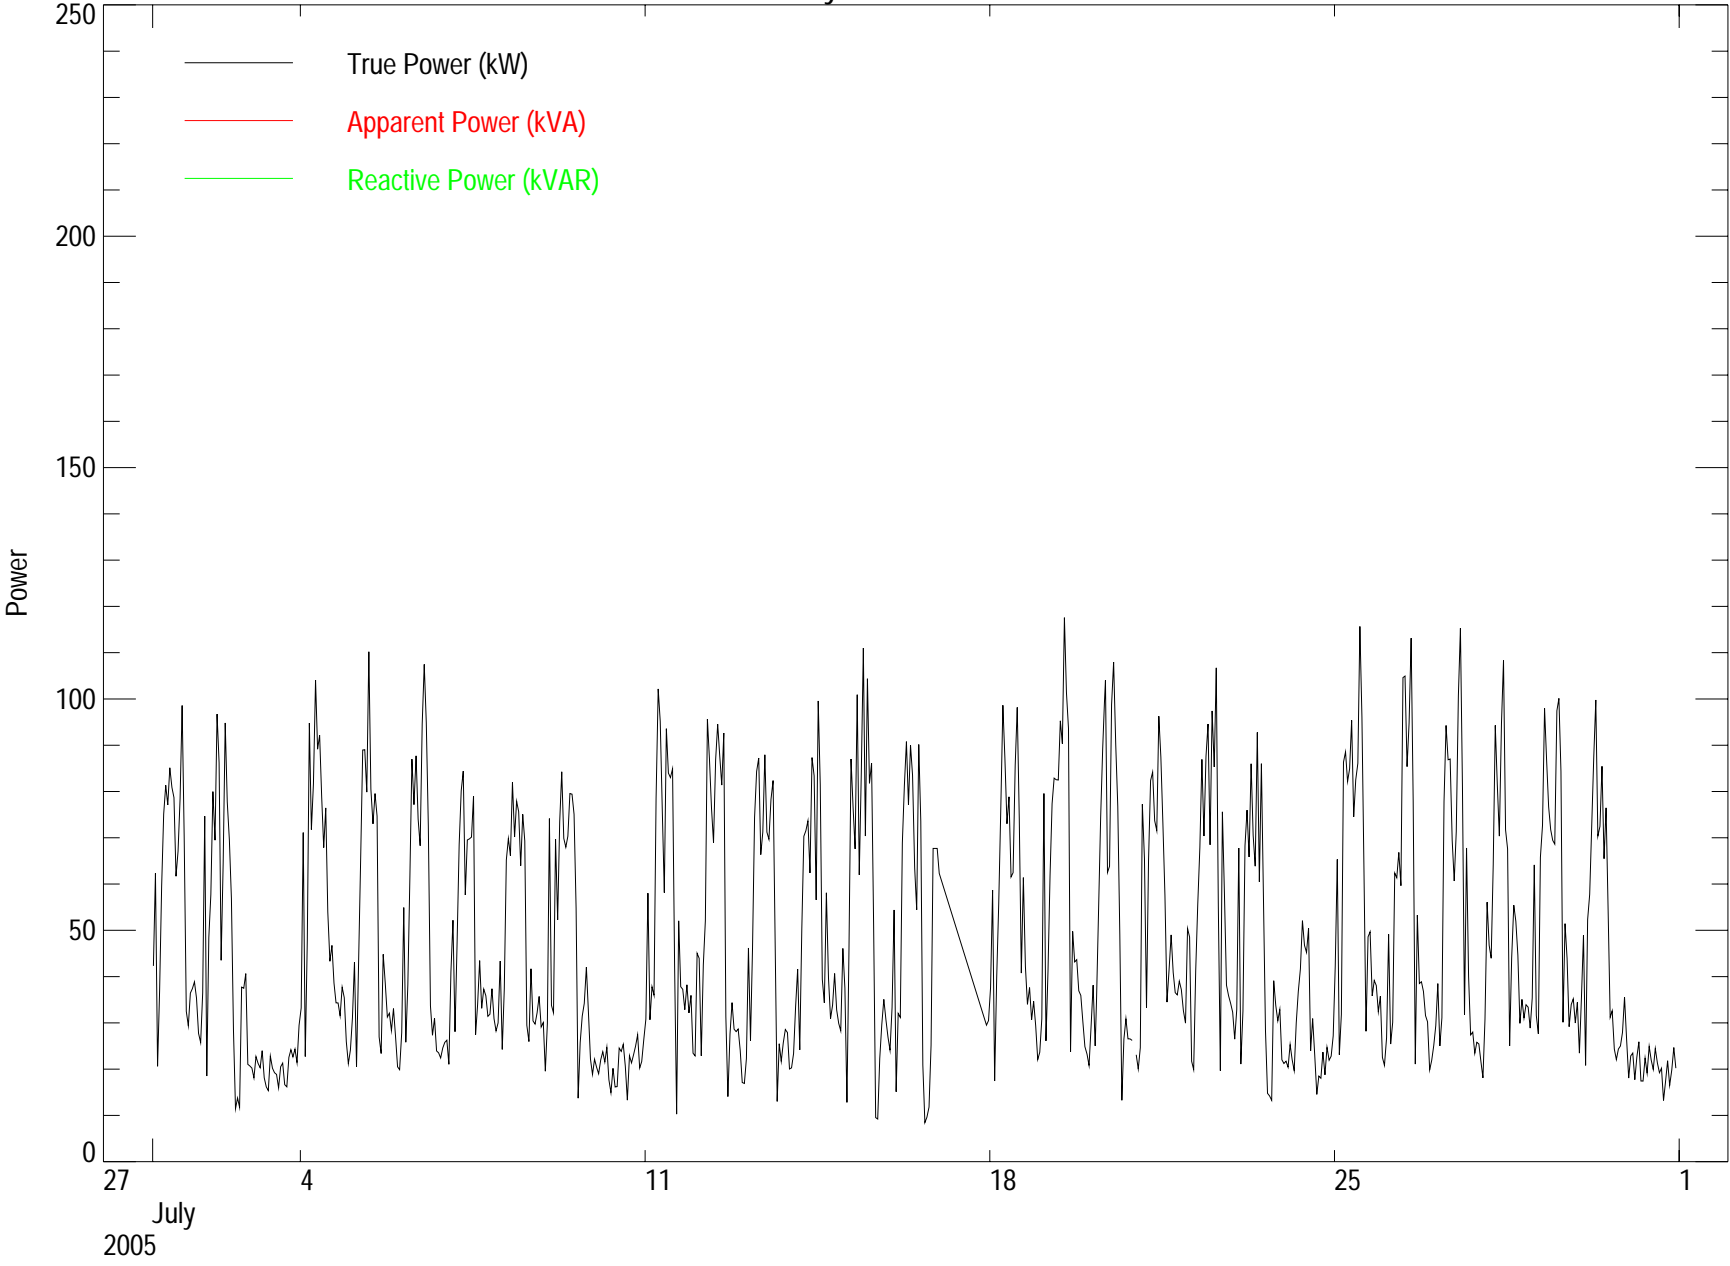

Facility Voltage

