

FACILITY POWER QUALITY - DATA SUMMARY

Arrow Linen

08/01/05 to 08/31/05

Generator Off

	Line 1			Line 2			Line 3			Totals		
	Min	Avg	Max	Min	Avg	Max	Min	Avg	Max	Min	Avg	Max
Voltage (V)	12.3	125.8	128.3	86.2	125.0	127.5	99.3	125.1	127.4	n/a	n/a	n/a
Current (amps)	-	-	-	-	-	-	-	-	-	n/a	n/a	n/a
True Power (kW)	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	11.0	40.3	246.8
Apparent Power (kVA)	-	-	-	-	-	-	-	-	-	-	-	-
Power Factor (-)	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	-	-	-
Voltage THD (%)	-	-	-	-	-	-	-	-	-	n/a	n/a	n/a
Current THD (%)	-	-	-	-	-	-	-	-	-	n/a	n/a	n/a
Frequency (hz)	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	-	-	-

Generator On

	Line 1			Line 2			Line 3			Totals		
	Min	Avg	Max	Min	Avg	Max	Min	Avg	Max	Min	Avg	Max
Voltage (V)	116.9	121.7	128.1	111.7	121.4	126.8	117.9	121.5	127.1	n/a	n/a	n/a
Current (amps)	-	-	-	-	-	-	-	-	-	n/a	n/a	n/a
True Power (kW)	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	-0.4	64.2	362.2
Apparent Power (kVA)	-	-	-	-	-	-	-	-	-	-	-	-
Power Factor (-)	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	-	-	-
Voltage THD (%)	-	-	-	-	-	-	-	-	-	n/a	n/a	n/a
Current THD (%)	-	-	-	-	-	-	-	-	-	n/a	n/a	n/a
Frequency (hz)	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	-	-	-


FACILITY POWER QUALITY - DATA SUMMARY

Arrow Linen

08/01/05 to 08/31/05

Date	Good Data (%)	Facility Apparent Power (kVAh)	Facility Reactive Power (kVARh)	Facility True Power (kWh)	Power Factor (-)
08/01/05	98.96	-	-	1181.00	-
08/02/05	100.00	-	-	1228.90	-
08/03/05	100.00	-	-	1161.50	-
08/04/05	100.00	-	-	1216.00	-
08/05/05	100.00	-	-	1339.50	-
08/06/05	100.00	-	-	1087.30	-
08/07/05	100.00	-	-	576.20	-
08/08/05	100.00	-	-	1273.50	-
08/09/05	100.00	-	-	1259.60	-
08/10/05	100.00	-	-	1216.70	-
08/11/05	100.00	-	-	1178.20	-
08/12/05	100.00	-	-	1398.50	-
08/13/05	100.00	-	-	1435.10	-
08/14/05	100.00	-	-	917.00	-
08/15/05	100.00	-	-	1206.40	-
08/16/05	100.00	-	-	1098.40	-
08/17/05	100.00	-	-	1202.60	-
08/18/05	100.00	-	-	831.10	-
08/19/05	100.00	-	-	1109.40	-
08/20/05	95.83	-	-	999.60	-
08/21/05	3.13	-	-	18.10	-
08/22/05	100.00	-	-	1000.60	-
08/23/05	100.00	-	-	1818.10	-
08/24/05	100.00	-	-	840.30	-
08/25/05	100.00	-	-	862.30	-
08/26/05	100.00	-	-	1407.60	-
08/27/05	100.00	-	-	1671.80	-
08/28/05	100.00	-	-	728.00	-
08/29/05	100.00	-	-	1873.30	-
08/30/05	100.00	-	-	1283.50	-
08/31/05	95.83	-	-	1304.00	-
Total	96.57	-	-	35724.10	-

Facility Purchased Power

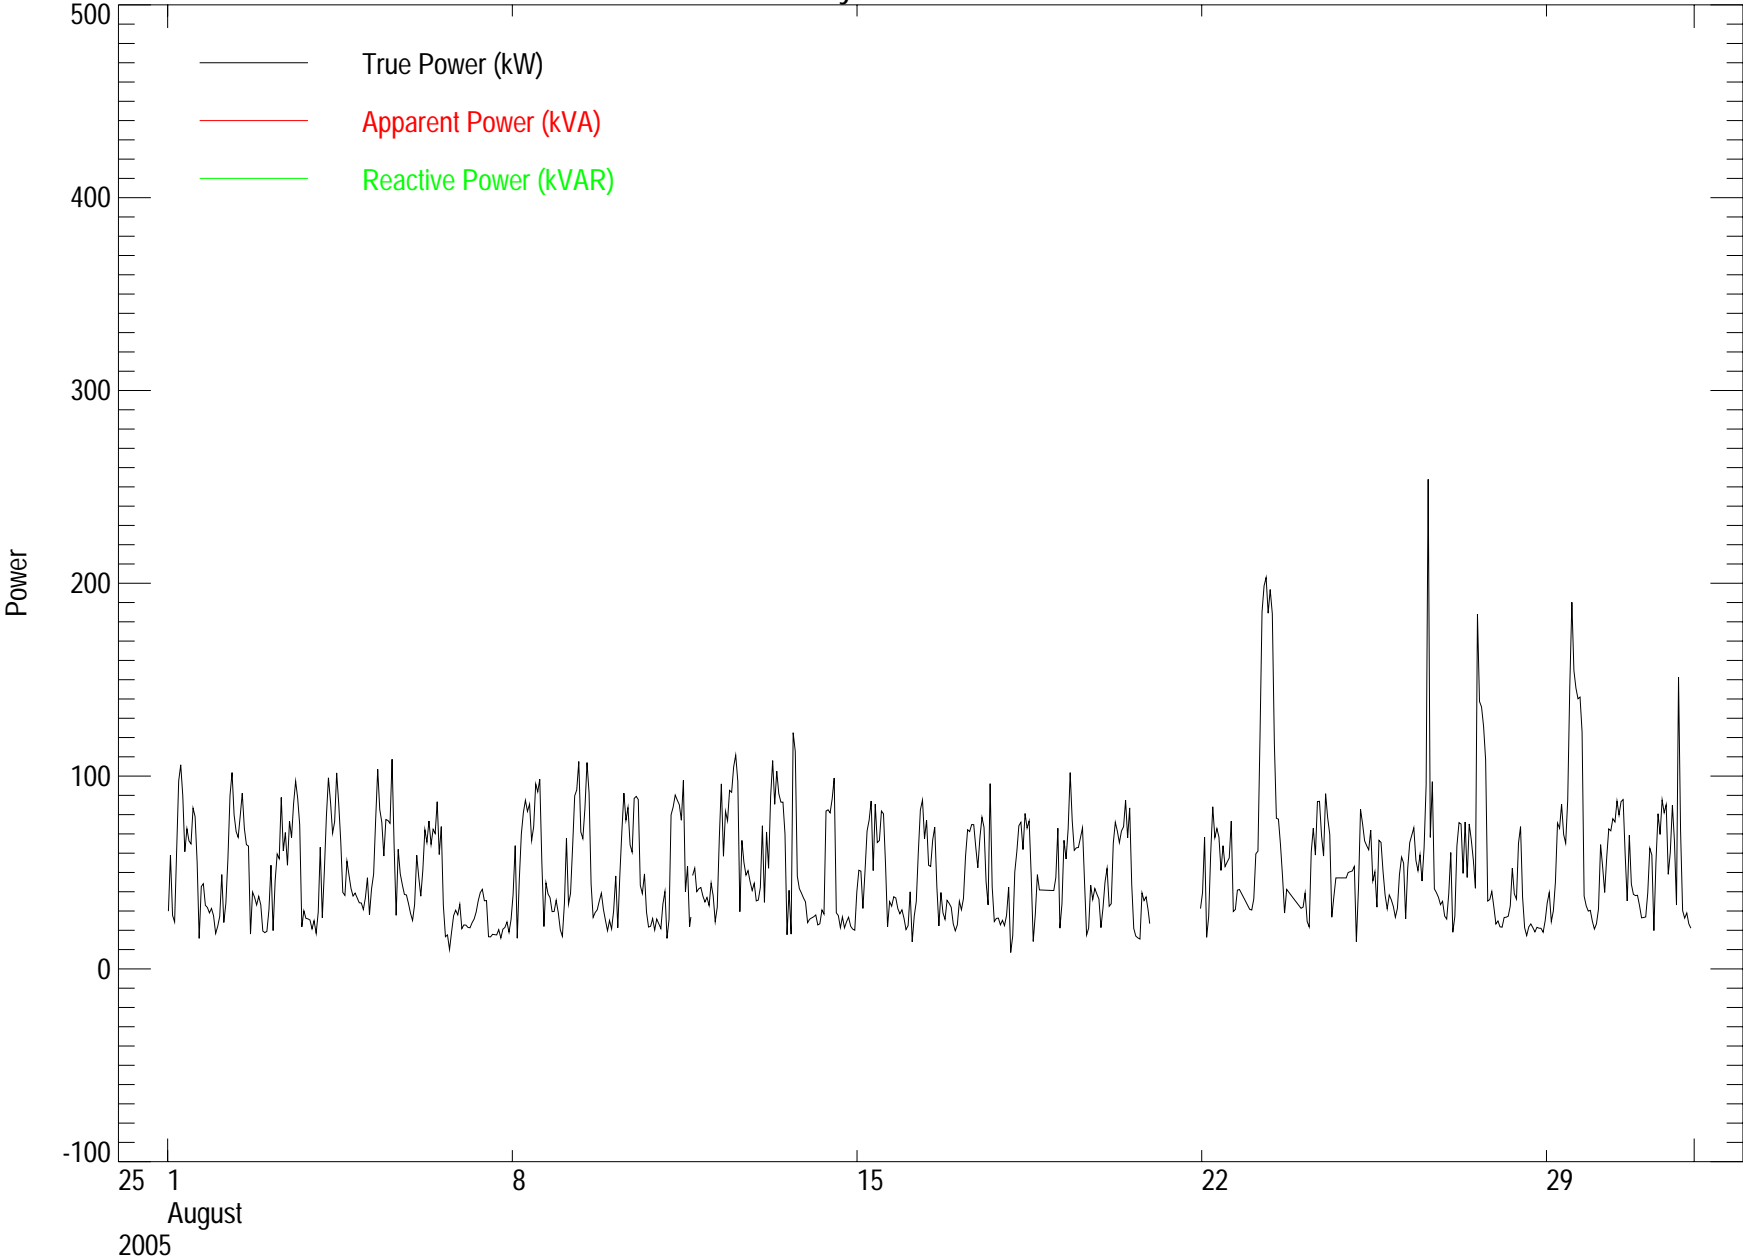

Facility Voltage

