

## FACILITY POWER QUALITY - DATA SUMMARY

Arrow Linen

02/01/09 to 02/28/09

### Generator Off

	Line 1			Line 2			Line 3			Totals		
	Min	Avg	Max	Min	Avg	Max	Min	Avg	Max	Min	Avg	Max
Voltage (V)	117.9	117.9	117.9	117.4	117.4	117.4	116.1	116.1	116.1	n/a	n/a	n/a
Current (amps)	1216.00	1216.00	1216.00	1126.00	1126.00	1126.00	1102.00	1102.00	1102.00	n/a	n/a	n/a
True Power (kW)	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	86.4	86.4	86.4
Apparent Power (kVA)	143.4	143.4	143.4	132.2	132.2	132.2	127.9	127.9	127.9	394.2	394.2	394.2
Power Factor (-)	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	-	-	-
Voltage THD (%)	1.80	1.80	1.80	1.60	1.60	1.60	1.70	1.70	1.70	n/a	n/a	n/a
Current THD (%)	10.10	10.10	10.10	10.70	10.70	10.70	10.00	10.00	10.00	n/a	n/a	n/a
Frequency (hz)	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	60.0	60.0	60.0

### Generator On

	Line 1			Line 2			Line 3			Totals		
	Min	Avg	Max	Min	Avg	Max	Min	Avg	Max	Min	Avg	Max
Voltage (V)	-	-	-	-	-	-	-	-	-	n/a	n/a	n/a
Current (amps)	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
True Power (kW)	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	-	-	-
Apparent Power (kVA)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
Power Factor (-)	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	-	-	-
Voltage THD (%)	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
Current THD (%)	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
Frequency (hz)	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	-	-	-


# FACILITY POWER QUALITY - DATA SUMMARY

Arrow Linen

02/01/09 to 02/28/09

Date	Good Data (%)	Facility Apparent Power (kVAh)	Facility Reactive Power (kVARh)	Facility True Power (kWh)	Power Factor (-)
02/01/09	100.00	9460.45	9230.40	0.00	-
02/02/09	100.00	9460.45	9230.40	0.00	-
02/03/09	100.00	9460.45	9230.40	0.00	-
02/04/09	100.00	9460.45	9230.40	0.00	-
02/05/09	100.00	9460.45	9230.40	0.00	-
02/06/09	100.00	9460.45	9230.40	0.00	-
02/07/09	100.00	9460.45	9230.40	0.00	-
02/08/09	100.00	9460.45	9230.40	0.00	-
02/09/09	100.00	9460.45	9230.40	0.00	-
02/10/09	100.00	9460.45	9230.40	0.00	-
02/11/09	100.00	9460.45	9230.40	0.00	-
02/12/09	100.00	9460.45	9230.40	0.00	-
02/13/09	100.00	9460.45	9230.40	0.00	-
02/14/09	100.00	9460.45	9230.40	0.00	-
02/15/09	100.00	9460.45	9230.40	0.00	-
02/16/09	100.00	9460.45	9230.40	0.00	-
02/17/09	100.00	9460.45	9230.40	0.00	-
02/18/09	100.00	9460.45	9230.40	0.00	-
02/19/09	100.00	9460.45	9230.40	0.00	-
02/20/09	100.00	9460.45	9230.40	0.00	-
02/21/09	100.00	9460.45	9230.40	0.00	-
02/22/09	100.00	9460.45	9230.40	0.00	-
02/23/09	100.00	9460.45	9230.40	0.00	-
02/24/09	100.00	9460.45	9230.40	0.00	-
02/25/09	100.00	9460.45	9230.40	0.00	-
02/26/09	100.00	9460.45	9230.40	0.00	-
02/27/09	100.00	9460.45	9230.40	0.00	-
02/28/09	1.04	98.55	96.15	0.00	-
Total	96.47	255530.69	249316.95	0.00	-


# Facility Purchased Power

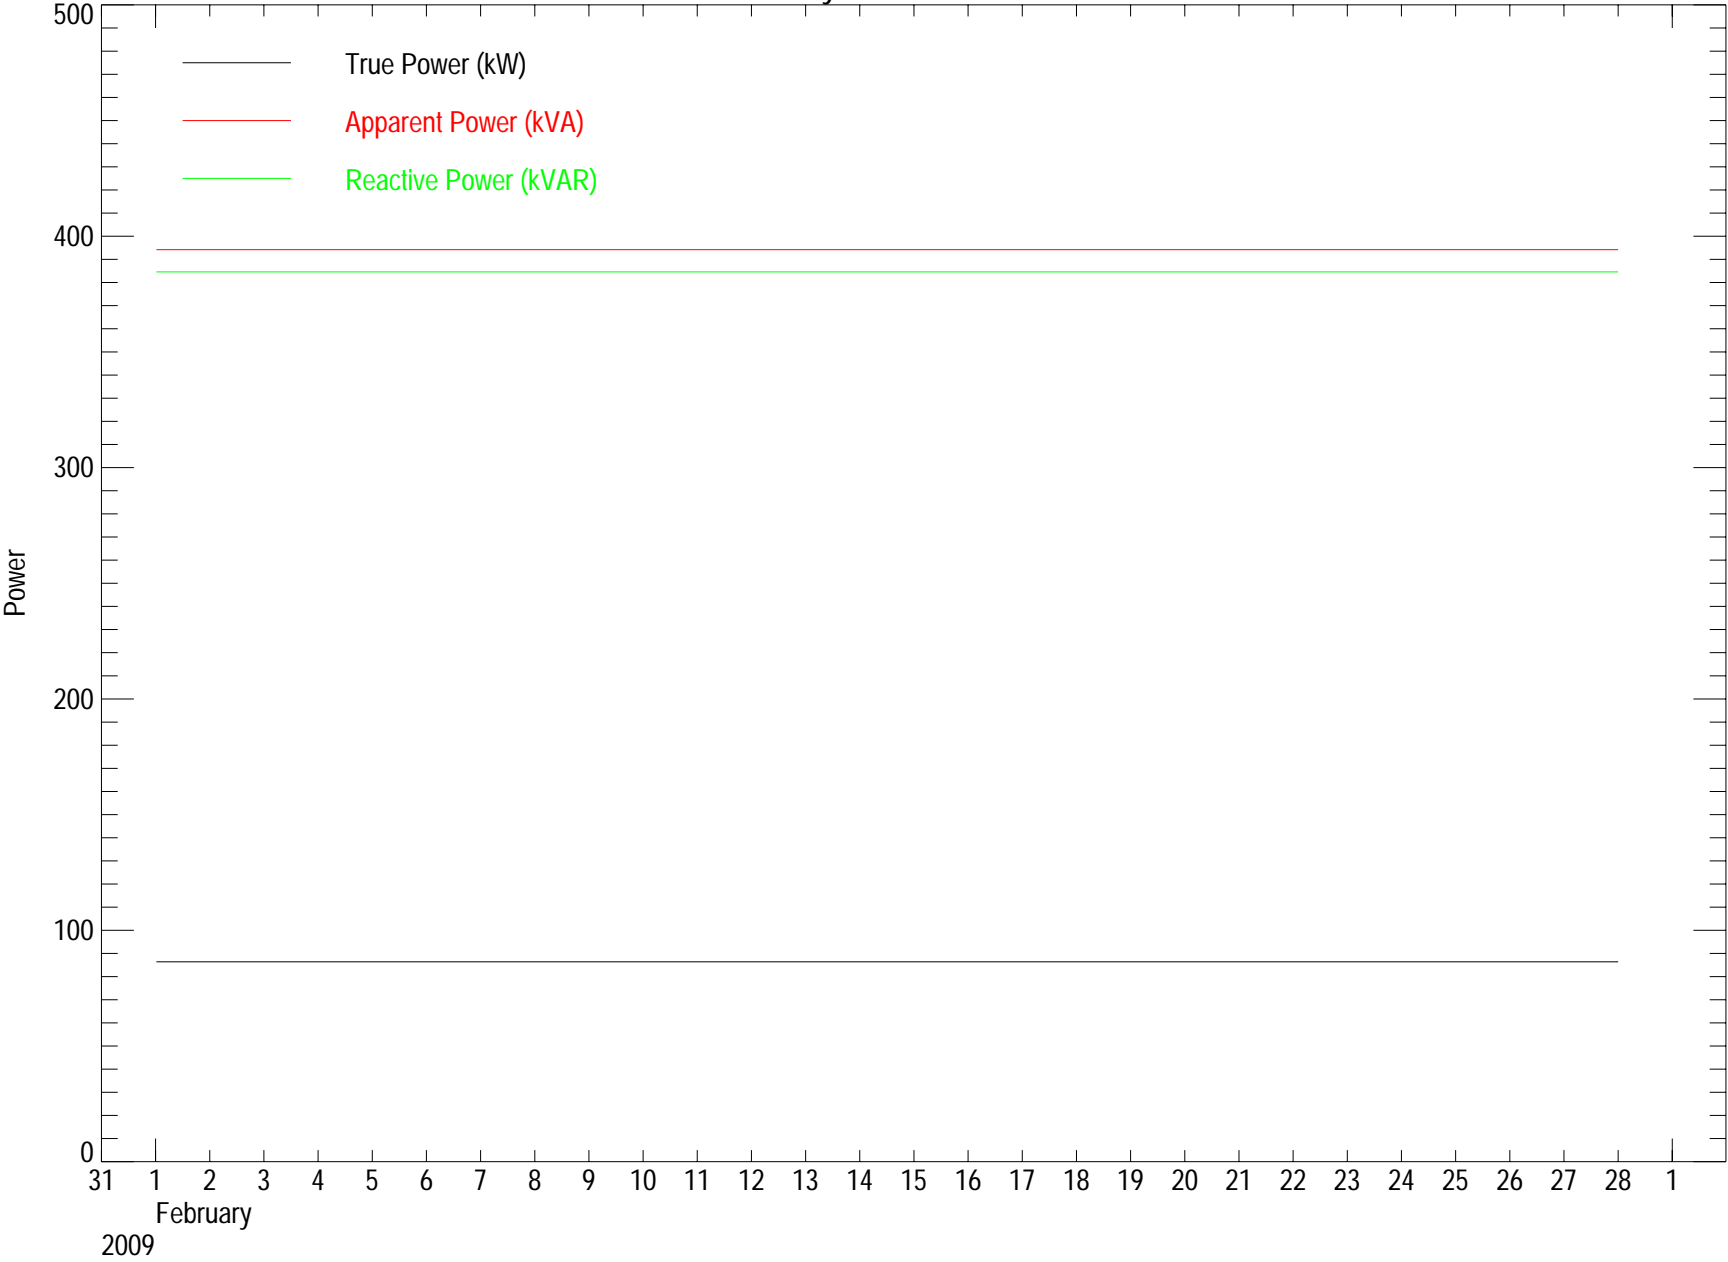

# Facility Voltage



# Facility Purchased Current

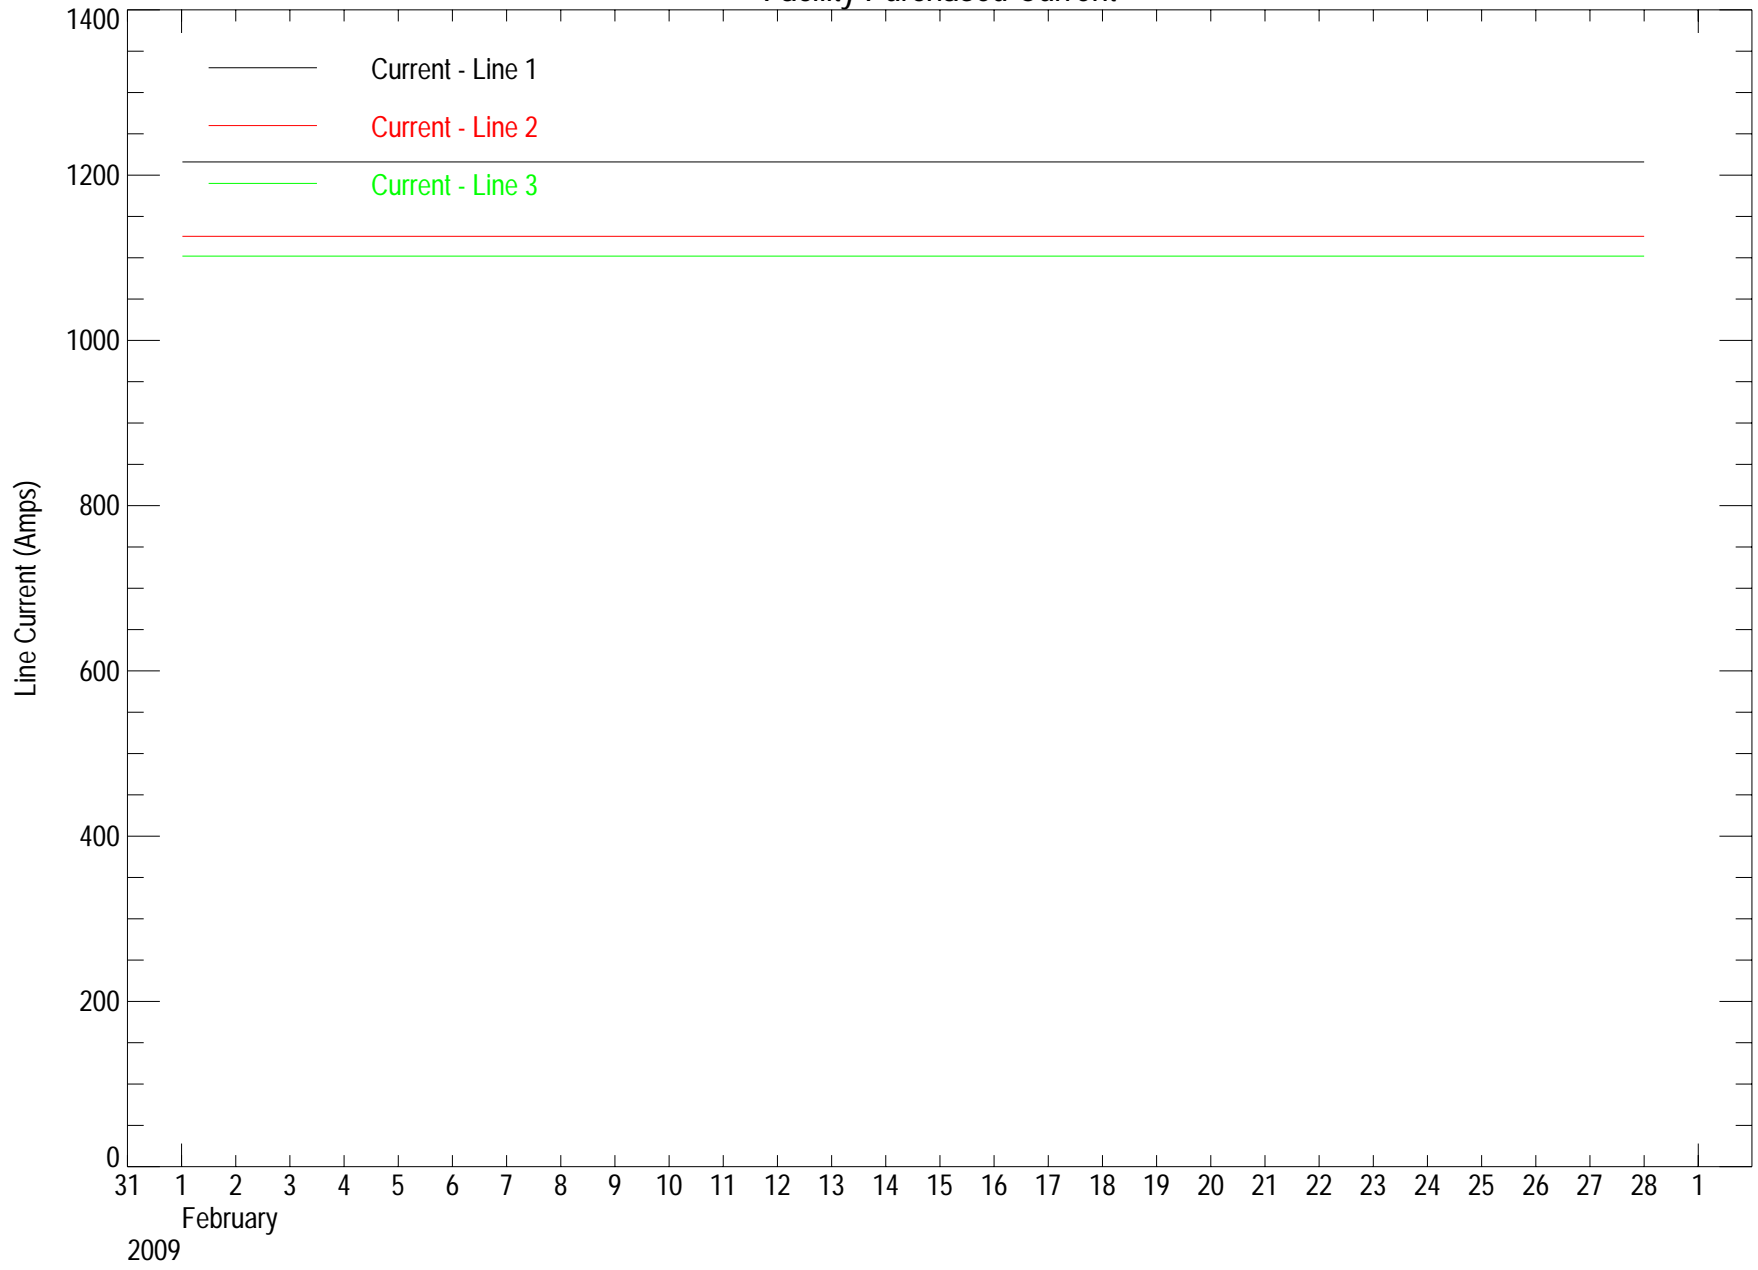

Facility Current Total Harmonic Distortion per Line



Facility Voltage Total Harmonic Distortion per Line

